


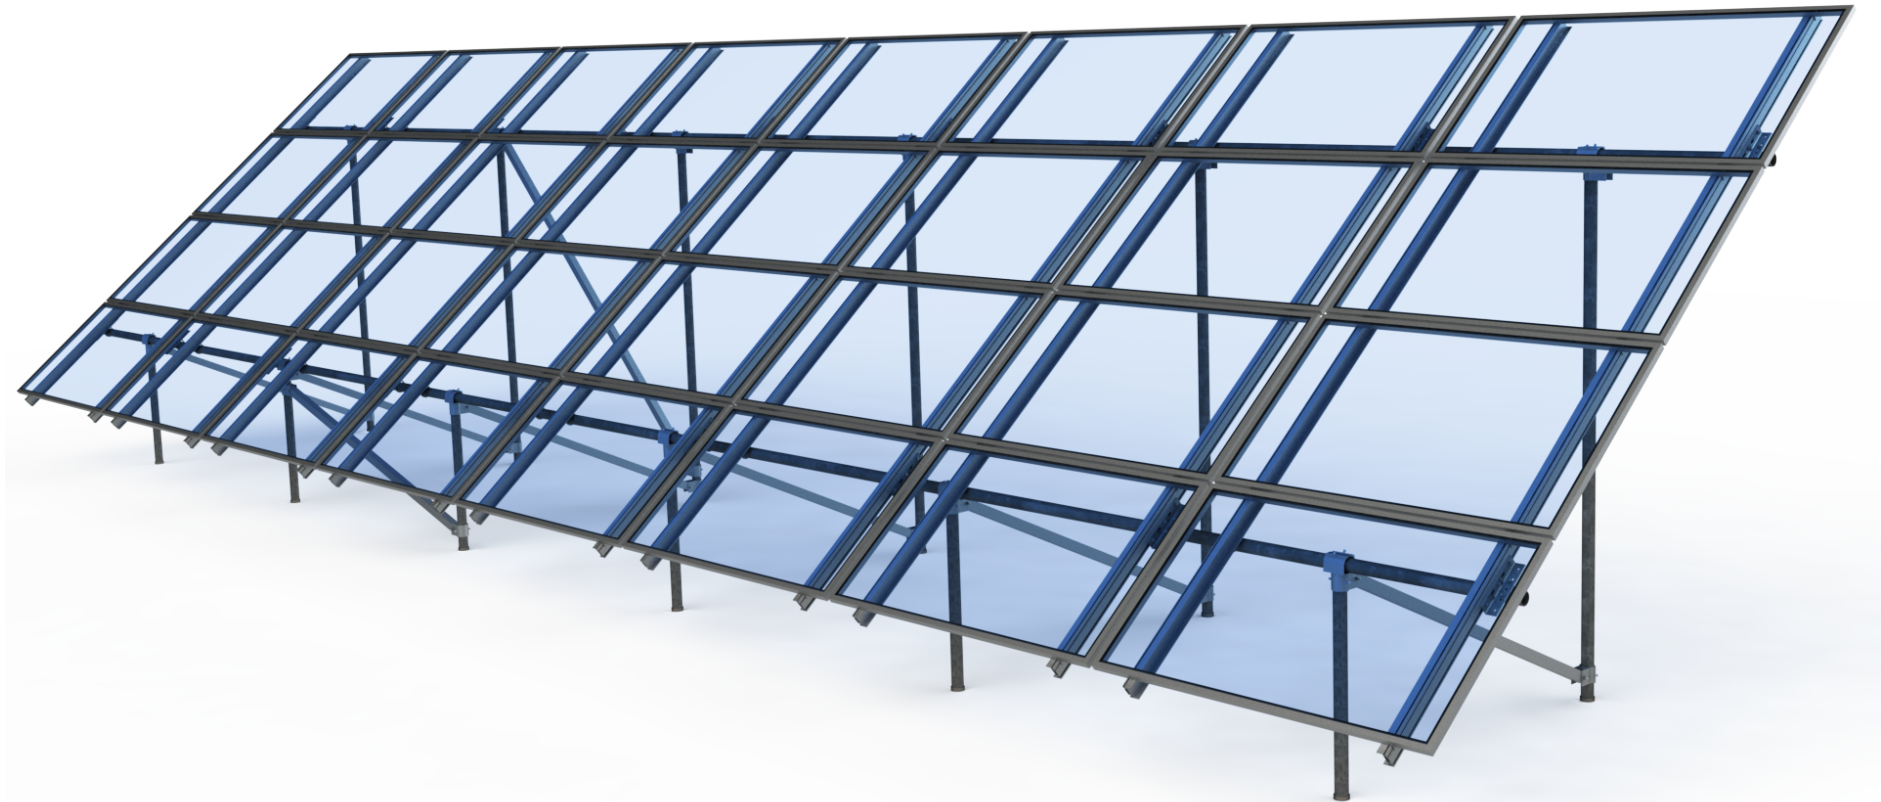

UNIRAC Code-Compliant Installation Manual

© 2021 by Unirac, Inc. All rights reserved.

TABLE OF CONTENTS

SYSTEM COMPONENTS.....	1-4
SYSTEM LAYOUT.....	5-7
SYSTEM ASSEMBLY	8-9
SPLICE ASSEMBLY	10
MICROINVERTER MOUNTING	11
STANDARD SYSTEM GROUNDING	12-13
STANDARD SERIES CLAMPS: ENDCLAMP & FIRST MODULE	14
STANDARD SERIES CLAMPS: BONDING MIDCLAMP.....	15
STANDARD SERIES CLAMPS: REMAINING MODULES.....	16
BONDING CONNECTIONS & GROUNDING PATHS.....	17-19
CODE COMPLIANCE NOTES	20
MECHANICAL LOAD TEST	21
COMPATIBLE MODULES	22-27
APPENDIX A	
PRO SERIES CLAMPS: ENDCLAMP AND FIRST MODULE	28
MID CLAMP INSTALLATION	29
APPENDIX B	
UAF END CLAMP INSTALLATION	30
UAF MID CLAMP INSTALLATION	31

Installer responsibility



The installer is solely responsible for:

- Complying with all local or national building codes, including any that may supersede this manual.
- Ensuring that UNIRAC and other products are appropriate for the particular installations and installation environment.
- Ensuring safe installation of all electrical aspects of the PV array.

ULA COMPONENTS

Components and quantities specific to your installations are listed on your quotation.



Note: Incidental materials such as temporary bracing or gravel may be necessary.

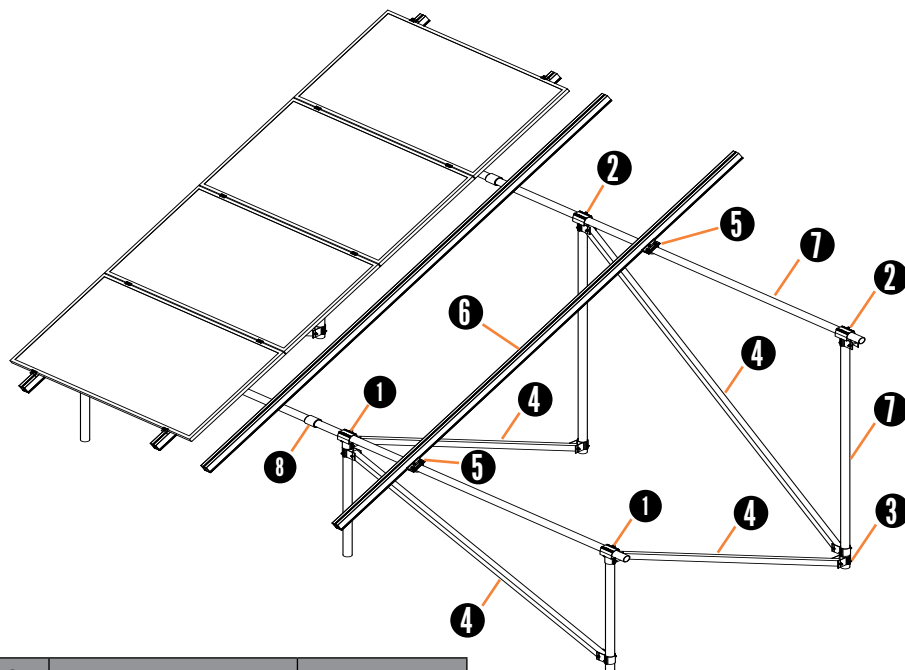

- 1 Front cap:** Attaches front horizontal pipe and upper end of North-South braces to vertical pipe. Included hardware: (2) U-bolts, cross-brace bolt, (5) flange nuts, set screws.

2



- Rear cap:** Attaches back horizontal pipe and upper end of East-West braces to vertical pipes. Included hardware: (2) U-bolts, (4) flange nuts, set screws.



- 3 Slider (Optional):** Attaches lower end of North-South cross brace and both ends of East-West braces to vertical pipes. Included Hardware: (1) cross-brace bolt, (1) flange nut, set screws.

4

- Cross Brace (Optional):** Provides North-South and East-West diagonal bracing. *See design guide or U-Builder




- 5 Rail Bracket:** Attaches rail to horizontal pipes. Included hardware: (1) U-bolt, (1) 1/2 inch bolt, and (2) flange nuts.

6

SOLARMOUNT OR GFT Rails:



SM Standard or GFT rails support PV modules.



S.NO.	PART	PART NUMBER
1	Front cap	403211C
2	Rear cap	403214C
3	Slider (Optional)	403215C
4	Cross Brace (Optional)	403200C
5	Rail Bracket	403216M
6	SM Rail CLR	310xxxC
	SM Rail DRK	310xxxD
	SM Rail MILL	320xxxM
	GFT Rail	411166M

Note:
East-West Cross Braces must be installed in pairs with a rear and a front brace connected to the same vertical pipe bay.

- Brace pairs can be installed on any leg pair in the array.
- Bonding Clamps are Single use only.

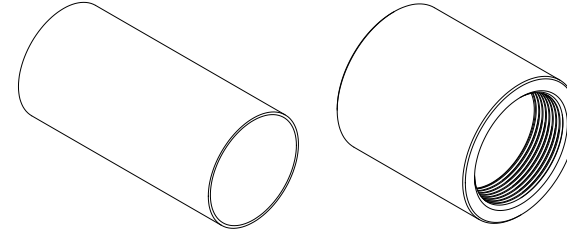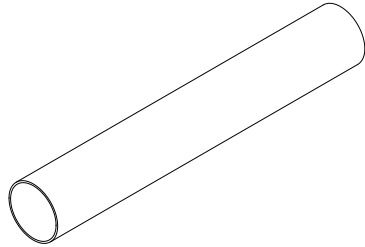


7 2 INCH DIA PIPE (USER SUPPLIED): Provides vertical and East-West support. Unirac approved 2 inch pipes are SCH40 pipe and Gatorshield coated mechanical pipe. Installer may choose either option based on project requirements.

8 2 INCH DIA SPLICE (USER SUPPLIED): Splice joins two pipes into single pipe length. It is installer's responsibility to choose compatible splice for the pipe used at project location.

ULA PORTRAIT ARRAY

Portrait arrays utilize the same components as landscape arrays.

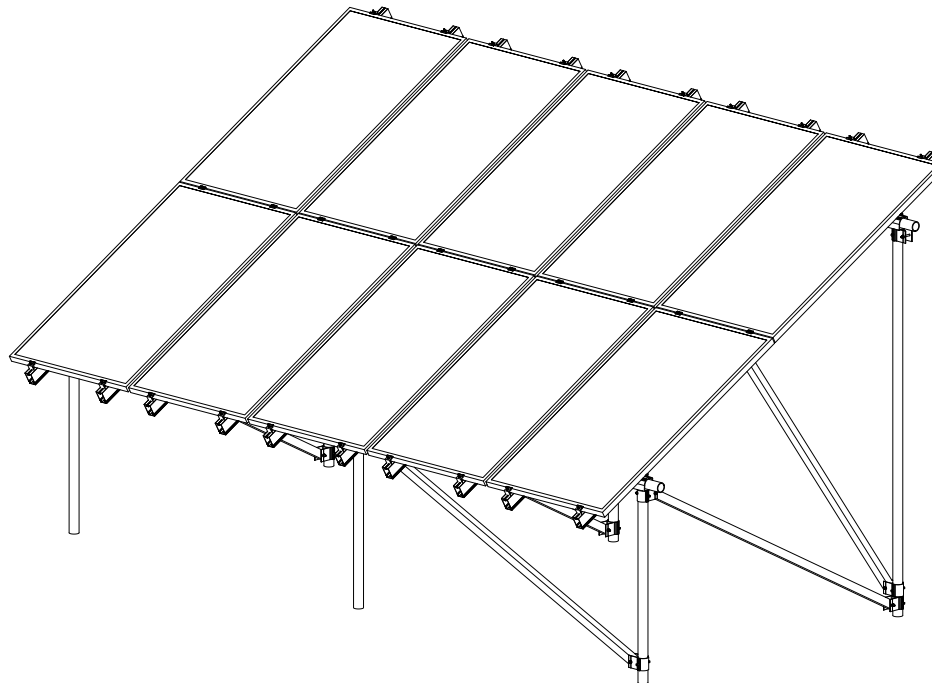

MATERIAL SPECIFICATIONS

Rails, caps, sliders, rail brackets, cross braces, bottom mounting clips, and top mounting clamps: 6105-T5 aluminum extrusion; caps are welded.

Fasteners: 304 stainless steel.


Concrete (installer supplied):

Rated for a minimum of 2,500 pounds per square inch.

Horizontal and vertical pipe (installer supplied):

UNIRAC approved 2" pipe specifications

ALTERNATIVE- 1

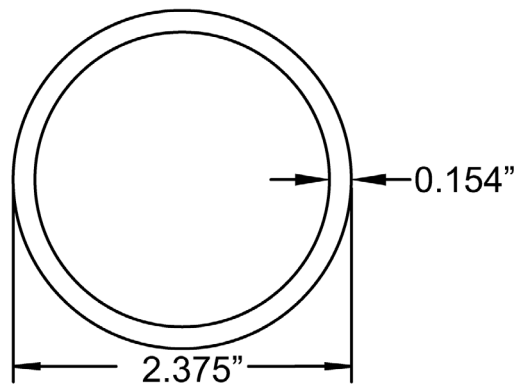


ASTM SCH40
2" PIPE

PROPERTIES

- ASTM A53 B Schedule 40 Pipe
- Yield Strength: 35 KSI
- Hot Dipped Galvanized

ALTERNATIVE- 2

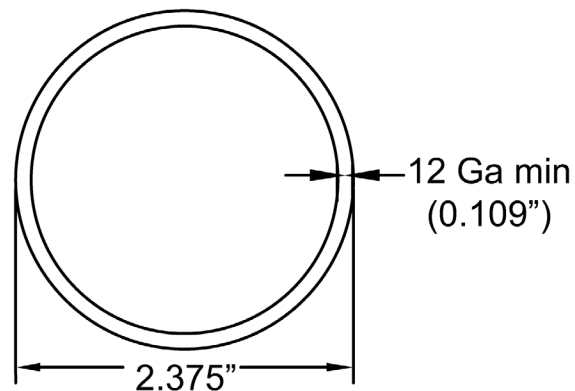

MECHANICAL 2" PIPE
(Gatorshield)

PROPERTIES

- Yield Strength: 50 KSI
- Galvanized (Allied Gatorshield Coating)

NOTE:


Conduit is not an acceptable alternative for the horizontal and vertical members. Conduit is not structural and should only be used to protect wires.

MODULE MOUNTING COMPONENTS

Components and quantities specific to your installations are listed on your quotation.


Standard Series Clamps

Secure modules to rail with 0.25" gap between modules.

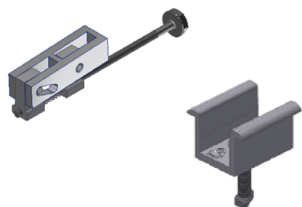

Pro Series Clamps

Secure modules to rail with 1" gap between modules.

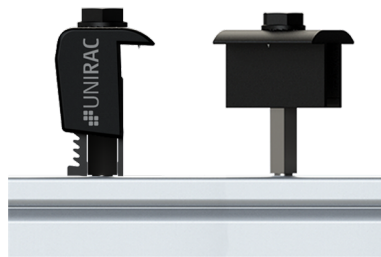

Universal AF Clamps

Secure modules to rail with 0.5" gap between modules

Note: Standard Series, Pro Series, and Universal AF clamps are single use only.

S.NO.	DESCRIPTION	PART NUMBER
1	SM ENDCLAMP B CLR AL (30-32 MM)	302021C
2	SM ENDCLAMP B DRK AL (30-32 MM)	302021D
3	SM ENDCLAMP C CLR AL (33-36 MM)	302022C
4	SM ENDCLAMP C DRK AL (33-36 MM)	302022D
5	SM ENDCLAMP D CLR AL (38-40 MM)	302023C
6	SM ENDCLAMP D DRK AL (38-40 MM)	302023D
7	SM ENDCLAMP E CLR AL (50-51 MM)	302024C
8	SM ENDCLAMP E DRK AL (50-51 MM)	302024D
9	SM ENDCLAMP F CLR AL (45-47 MM)	302025C
10	SM ENDCLAMP F DRK AL (45-47 MM)	302025D
11	SM ENDCLAMP K CLR AL (39-41 MM)	302026C
12	SM ENDCLAMP K DRK AL (39-41 MM)	302026D
13	SM BND MIDCLAMP BC SS	302027C
14	SM BND MIDCLAMP BC DRK SS	302027D
15	SM BND MIDCLAMP EF SS	302028C
16	SM BND MIDCLAMP EF DRK SS	302028D
17	SM BND MIDCLAMP DK SS	302029C
18	SM BND MIDCLAMP DK DRK SS	302029D
19	SM MIDCLAMP PRO DRK	302030D
20	SM MIDCLAMP PRO MILL	302030M
21	SM ENDCLAMP PRO W/CAP	302035M
22	UNIVERSAL AF MID CLAMP DRK	302045D
23	UNIVERSAL AF MID CLAMP MILL	302045M
24	UNIVERSAL AF END CLAMP DRK	302050D
25	UNIVERSAL AF END CLAMP MILL	302050M
26	GROUNDING LUG KIT	U-LUG

SYMBOL	DESCRIPTION
AL	ALUMINUM
CLR	CLEAR ANODIZED
DRK	DARK BRONZE ANODIZED
SS	STAINLESS STEEL
DRK SS	BLACK OXIDE COATED STAINLESS STEEL

FOUNDATIONS

Lay out and excavate leg positions

Consult the engineered plans to determine the North-South and East-West foundation spacing. Establish a grid and mark the foundation locations. Verify that all angles are square as shown in figure 1.

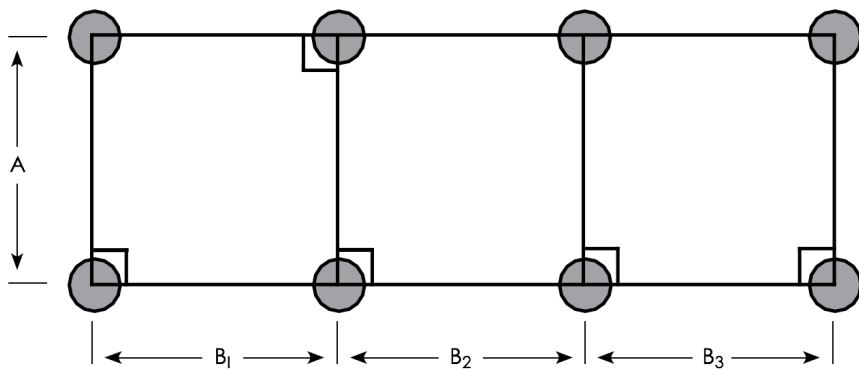


Figure - 1 North-South leg spacing (A) is fixed. East-West spacing (B₁, B₂, etc.) is identical in most installations, see "Average leg spacing E-W" (Nominal Values under "Design parameters") on page 2 of your Specs Sheet. However, if you needed to shift leg positions, follow the east - west spacing you set during your planning session.

SELECT AN ASSEMBLY SEQUENCE

The assembly sequence depends on installer preference and the size of the installation. Either of these options may be followed:

- If a ULA has just a few pairs (up to 3 pairs) of legs, installers may prefer to assemble the full truss structure prior to pouring concrete. See figure 2
- On the larger ULA structures with many pairs (more than 3 pairs) of legs, installers prefer to place the vertical leg pipes, pour the concrete, and let it cure overnight before installing. See figure 5.

Note: In either case, when mounting rails, be sure to center them on the horizontal pipes, which will leave about 20 percent overhang on north and south sides.

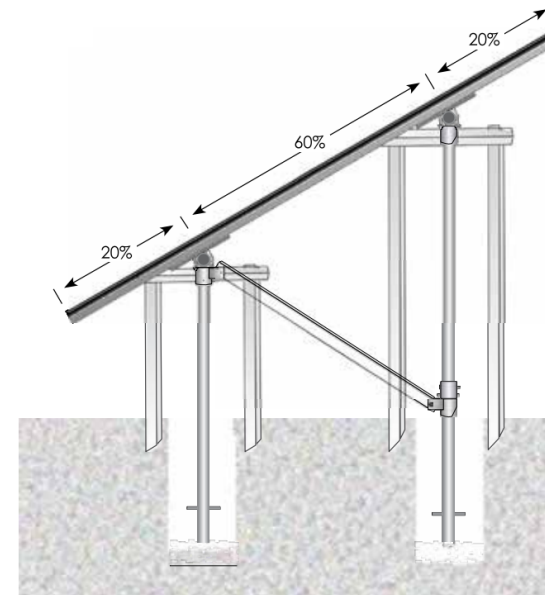


Figure 2

*Visit unirac.com/technical-support/ for more information on Ground Screw installation.

CONCRETE FOUNDATIONS

Prepare Foundation Holes

Dig foundation holes to the “Footing diameter” and “Footing depth” listed on page 2 of your Specs Sheet. Ensure holes are dug to the tolerances shown in figure 3. Verify that the footings extend below the frost line.

If shallow ground water is encountered, over excavating 4” and back filling with gravel no smaller than ¼” can be used to facilitate concrete placement. Concrete can not be placed in standing water.

Prepare Vertical Pipes

At the bottom of the vertical pipes, install a piece of rebar, threaded cap or bolts. This step prevents withdrawal from the footing. See figure 4.

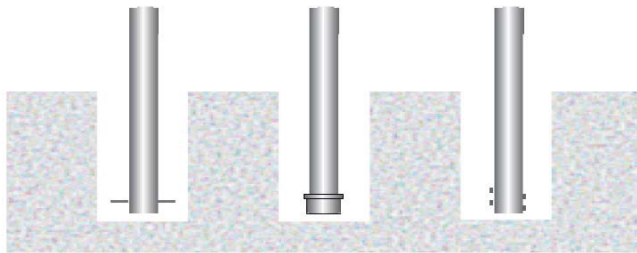


Figure-4

Pour Concrete & Position Pipes

Using wood braces to position the pipes to ensure they are level, square and aligned. Use a string line, laser level or transit to level the tops of the pipes down the row. See figure 5.

Place pipes and pour concrete. Shape the concrete to slope away from the legs to promote drainage away from the pipes. Allow concrete to cure before proceeding. See Figure 6.

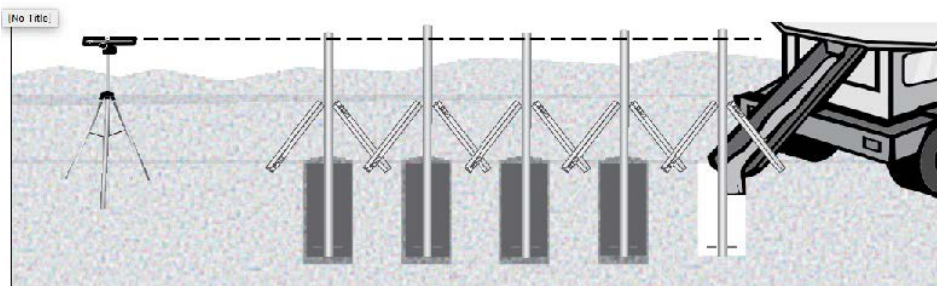


Figure-5

Acceptable Tolerances for Foundation Holes	
Diameter	-1"
Depth	-2"

Figure-3


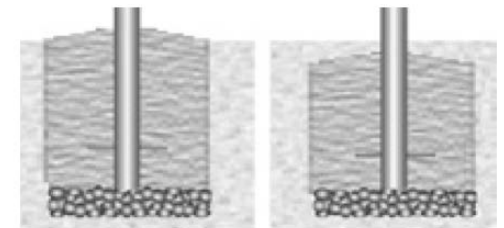


Figure-6

GROUND SCREW FOUNDATIONS

- Follow the respective Ground Screw manufacturer's installation instructions to install Ground Screws.
- Insert pipes or tubes into Ground Screws.
- Ensure minimum 12 inches of pipe is inserted into Ground Screws.

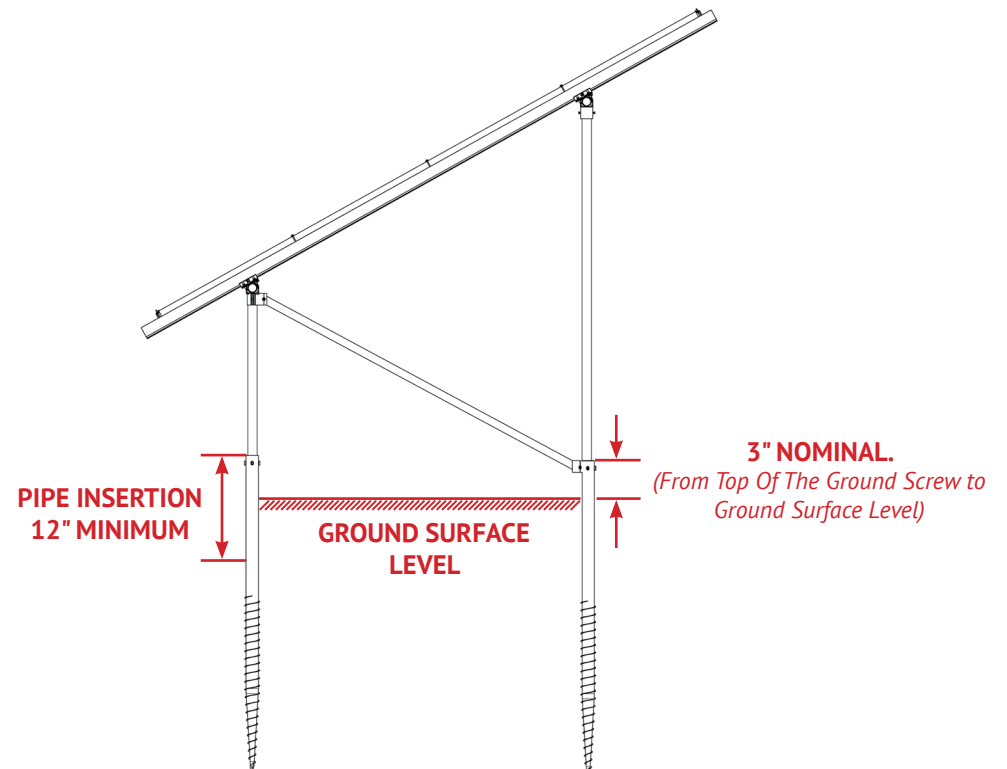


ASSEMBLY


Install sliders and braces as configured in the engineered plans. A forgotten slider can result in extensive disassembly. Make sure all of them are in place before proceeding. Consult the engineered plans to determine the configuration and placement of braces.

Torque all fasteners to the values shown below:


- Set screws for leg caps and sliders: 15 foot-pounds.
- 3/8-inch serrated flange nuts for U-bolts and rail brackets: 8 foot-pounds
- 1/4-inch module mounting hardware: 10 foot-pounds

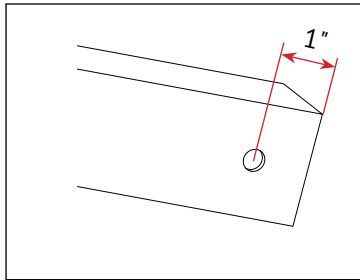


Cut brace to length and drill a hole on the centerline, 1" from end.

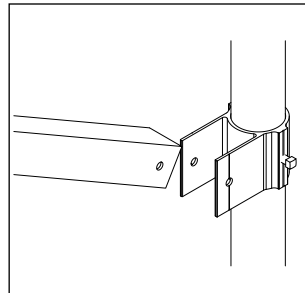


Install sliders onto pipe and tighten set screws.




Install brace onto slider and secure with provided hardware.




Place rear caps onto the North (taller) pipes and tighten screws.

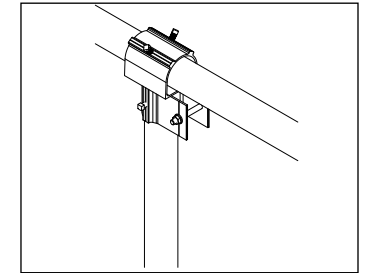



Slide the horizontal pipe into the caps and and tighten screws.

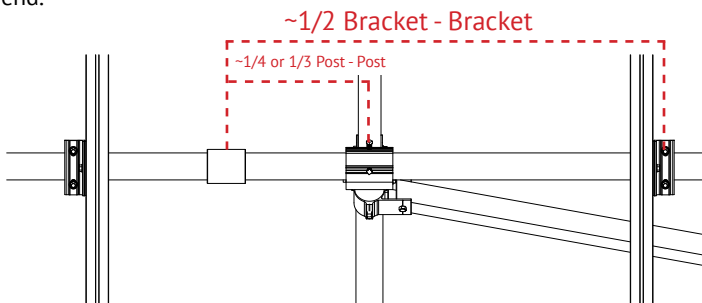

If pipe couplers are used, avoid conflicts by placing them one-quarter to one-third of the way between leg caps and midway between rail brackets.



Secure any braces to the caps and tighten the screws.



Repeat this process on the South row using front caps.


*See page 7 for GFT Rail Install

ASSEMBLY

Plan Bracket, Rail & Clamp Layout


Before installing rails, plan the layout and locations of Brackets, Rails and Modules to identify and resolve any conflicts with Front and Rear Caps. Measure and mark each module column on the horizontal pipe. Then, mark bracket and rail locations.

If a conflict is discovered, resolve it by using one or both of the methods shown below.

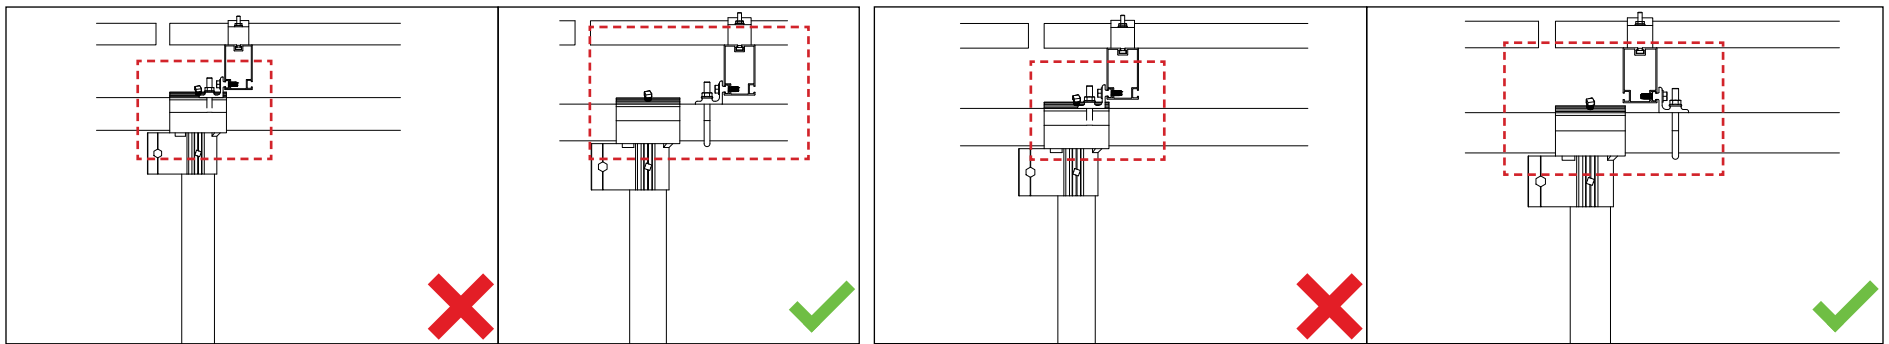

Solution-1 Shift rail & bracket east-west


Solution-2 Flip bracket connection to another slot

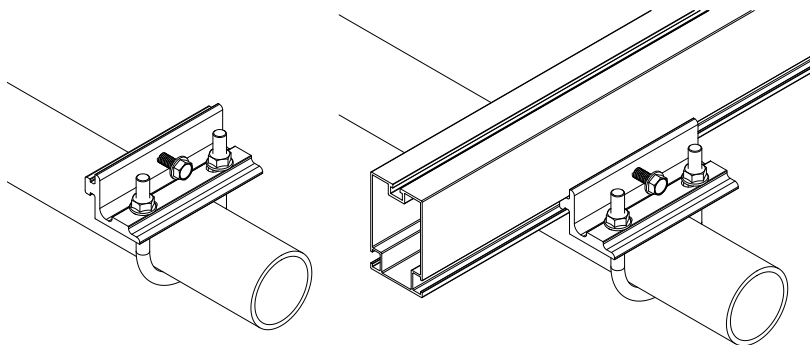

Install the bracket onto a top rail and tighten it.

TORQUE VALUE

3/8" Serrated flange nut for U-Bolt to 8 ft-lbs

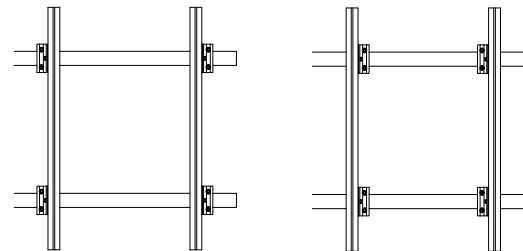

Center the rail over the horizontal pipes with overhangs on North and South sides of the array.


Secure the rail onto the bracket with the provided hardware by torquing the self threading bolt until it punctures and is snug to the rail.

Above images show the different Install orientations for Rail Bracket on rail.

NOTE:

1. If desired, North-South columns of modules can be pre-fabricated, mounted to rails and wired on the ground, or even off site, then lifted into position and secured to the horizontal pipes.
2. Please see design guide or U-Builder for guidance on rail type and bracket quantity.

Follow the below provided instructions to join two sections of pipes or tubes.

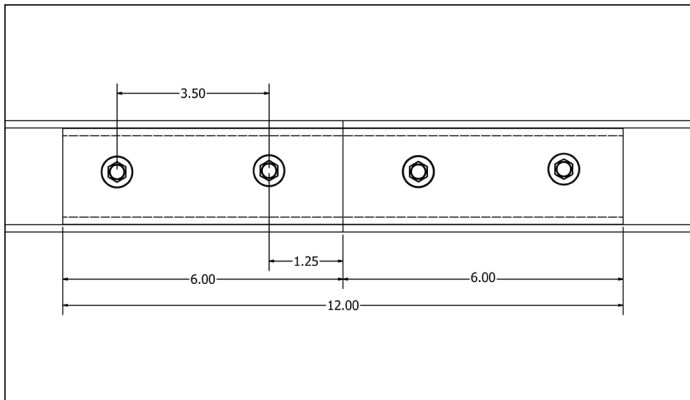

GATORSHIELD COATED(GC) PIPE SPLICE
(USER SUPPLIED)


SPECIFICATIONS:

- GC Pipe Size: 2.375" OD, 12 Gauge
- Splice Size: 2" OD, 9 Gauge, 12" Length
- Screw Size: 1/4"-14 x 3/4" self drilling screws

INSTRUCTIONS

- Cut GC splice to length.
- Insert 6" GC splice into one tube end.
- Position the first screw approximately 1.25" from the tube end and the second screw approximately 3.5" from the first screw.
- Tighten both screws to secure the splice to rail


Torque value: 9 ft-lbs.

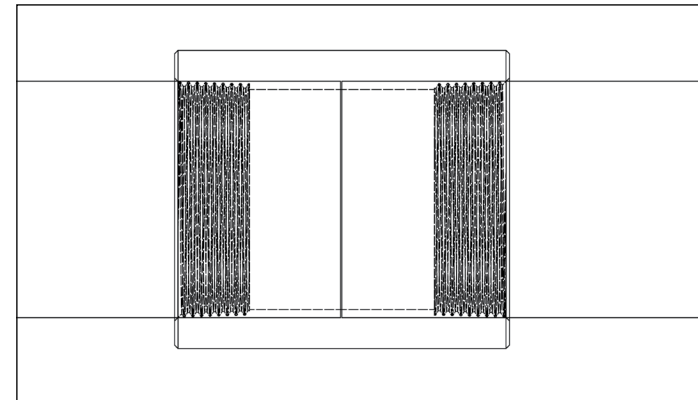

SCH40 PIPE SPLICE
(USER SUPPLIED)


INSTRUCTIONS

- Use galvanized threaded pipe couplings that match the pipe size used for system.
- Follow coupling manufacturer's instructions to securely connect two pipes.
- When splicing is required, use threaded Schedule 40 Grade B pipe.

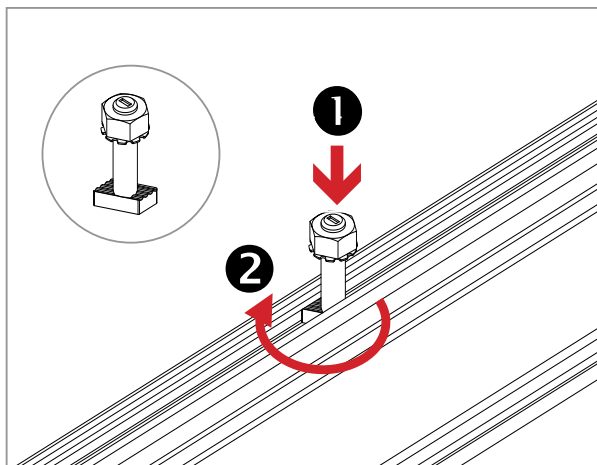

INSTALL MICROINVERTER MOUNT T-BOLT:


Apply Anti-Seize and install pre-assembled 1/4" dia. bonding T-bolts into top 1/4" rail slot at microinverter locations. Rotate bolts into position.

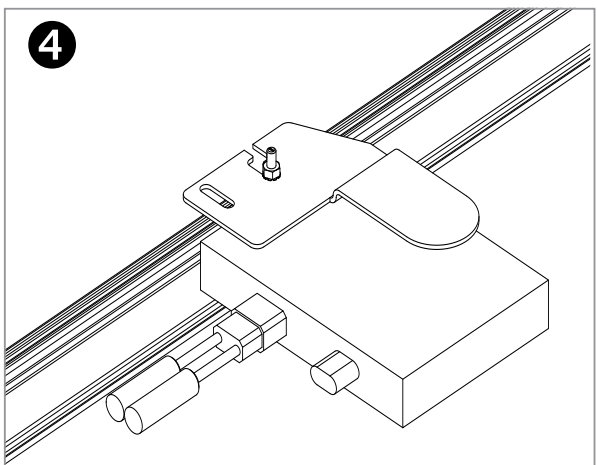

INSTALL MICROINVERTER:


Torque 1/4" nut to 10 ft-lbs with Anti-Seize.

NOTE: MLPE Mount is certified for single use only.

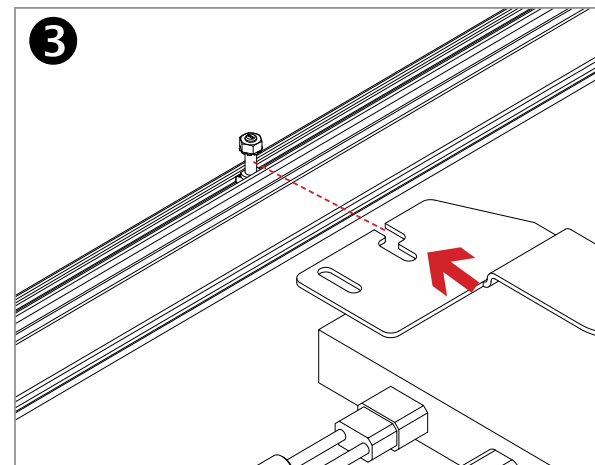

INSTALL MICROINVERTER:



Install microinverter on to rail. Engage with bolt.

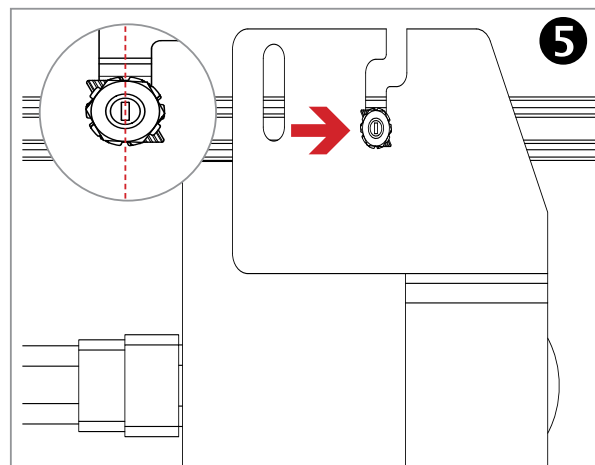


ALIGN POSITION INDICATOR:

Verify that position indicator on bolt is perpendicular to rail.

ONLY ONE LUG PER ARRAY:
Only one lug per array is required.

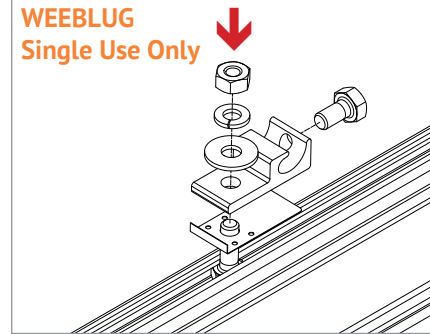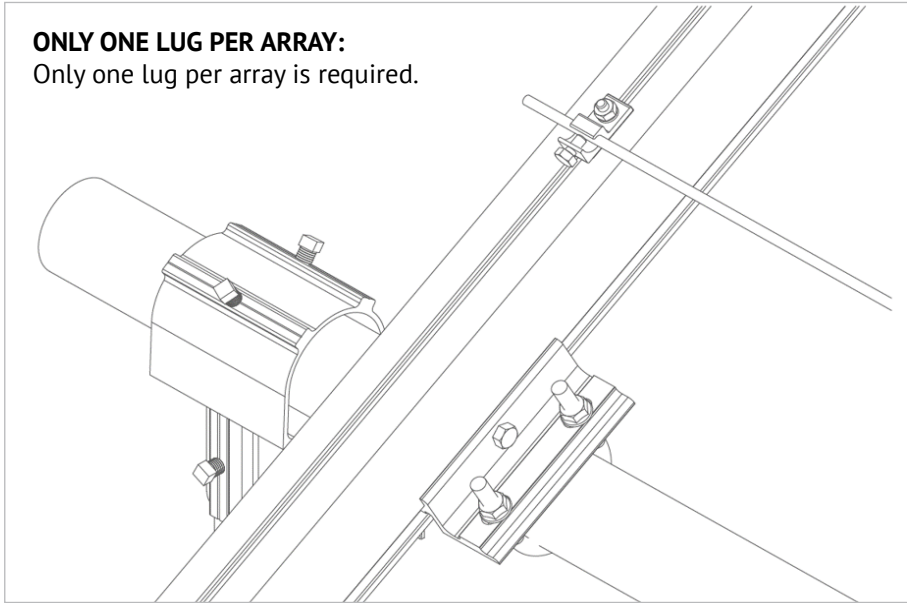

WEEB LUG
Single Use Only

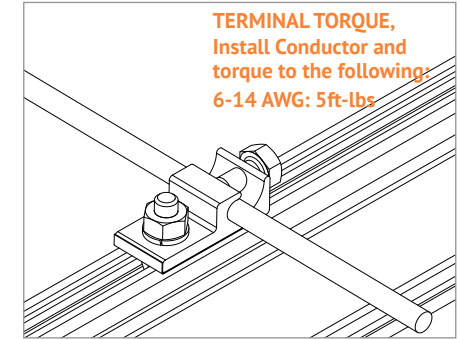

TERMINAL TORQUE,
Install Conductor and
torque to the following:
6-14 AWG: 5ft-lbs

WEEB LUG CONDUCTOR - UNIRAC P/N 008002S:


Apply Anti Seize and insert a bolt in the aluminum rail and through the clearance hole in the stainless steel flat washer. Place the stainless steel flat washer on the bolt, oriented so the dimples will contact the aluminum rail. Place the lug portion on the bolt and stainless steel flat washer. Install stainless steel flat washer, lock washer and nut. Tighten the nut until the dimples are completely embedded into the rail and lug.

TORQUE VALUE 10 ft lbs.


See product data sheet for more details, Model No. WEEB-LUG-6.7

GROUNDING LUG MOUNTING DETAILS:

Details are provided for the GROUNDING LUG, WEEB and IlSCO products. The WEEB Lug has a grounding symbol located on the lug assembly. The IlSCO lug has a green colored set screw for grounding indication purposes. The Grounding lug is Pre-assembled Lug Compatible with 0.25 inch T-Bolt slot Rails. Installation must be in accordance with NFPA NEC 70, however the electrical designer of record should refer to the latest revision of NEC for actual grounding conductor cable size.

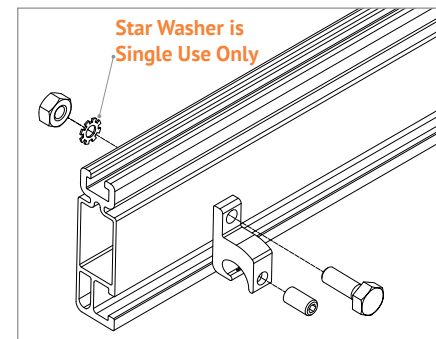

Star Washer is
Single Use Only

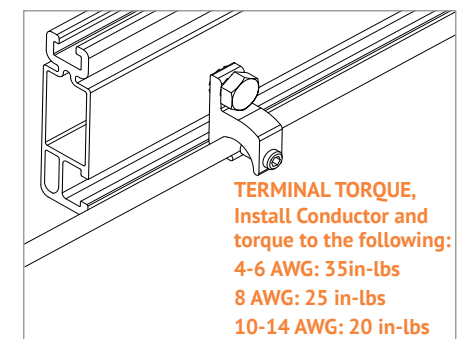

TERMINAL TORQUE,
Install Conductor and
torque to the following:
4-6 AWG: 35in-lbs
8 AWG: 25 in-lbs
10-14 AWG: 20 in-lbs

ILSCO LAY-IN LUG CONDUCTOR - UNIRAC P/N 008009P: Alternate Grounding Lug - Drill, deburr hole and bolt thru both rail walls per table.


TORQUE VALUE 5 ft lbs.

See ILSCO product data sheet for more details, Model No. GBL-4DBT.

NOTE: ISOLATE COPPER FROM ALUMINUM CONTACT TO PREVENT CORROSION


GROUNDING LUG - BOLT SIZE & DRILL SIZE			
GROUND LUG	Unirac P/N	BOLT SIZE	DRILL SIZE
Grounding Lug	U-LUG	1/4"	N/A - Place in Top SM Rail Slot
WEEB Lug	008002S	1/4"	N/A - Place in Top SM Rail Slot
ILSCO Lug	008009P	#10-32	7/32"
- Torque value for Grounding Lug is 10 ft-lbs. - Torque value for WEEB and ILSCO Lugs varies depending on conductor size.			

GROUNDING LUG - UNIRAC P/N U-LUG INSTALLATION STEPS :

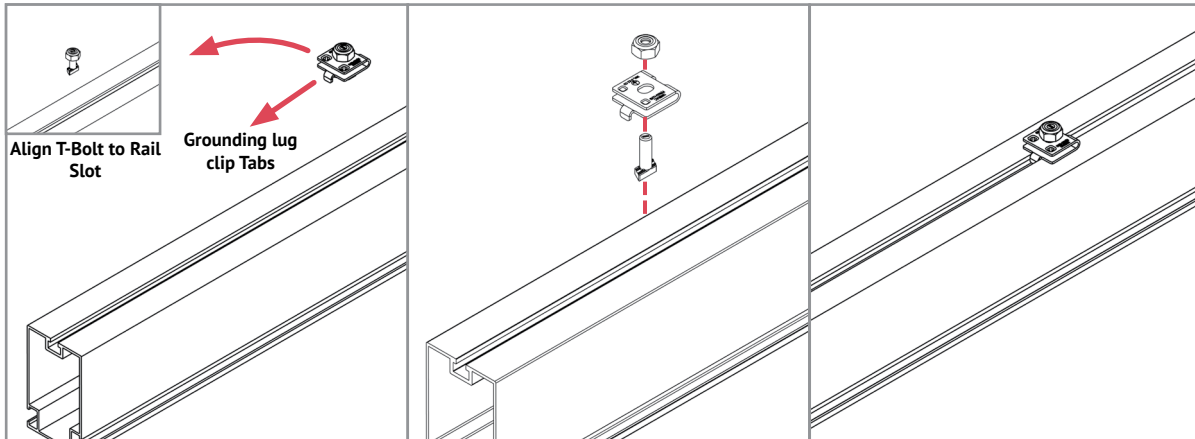


STEP 1: POSITION THE GROUNDING LUG

- Place the Grounding Lug on the rail with pre-assembled 1/4" T-bolt and nut.
- Ensure the Grounding Lug Clip tabs are positioned inside the rail.

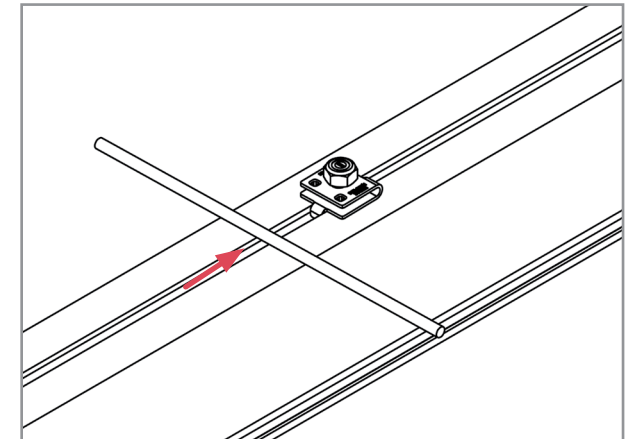


STEP 2: INSERT GROUNDING WIRE

- Insert the copper grounding wire (6-12 AWG) into the Grounding Lug Clip.

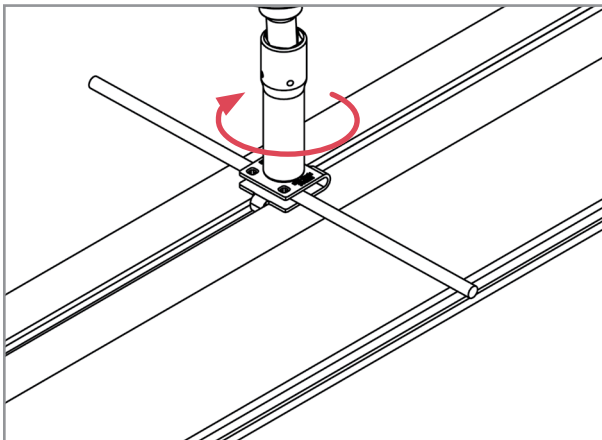


STEP 3: SECURE GROUNDING LUG TO RAIL

- Tighten the 1/4" nut to secure the Grounding Lug to Rail.

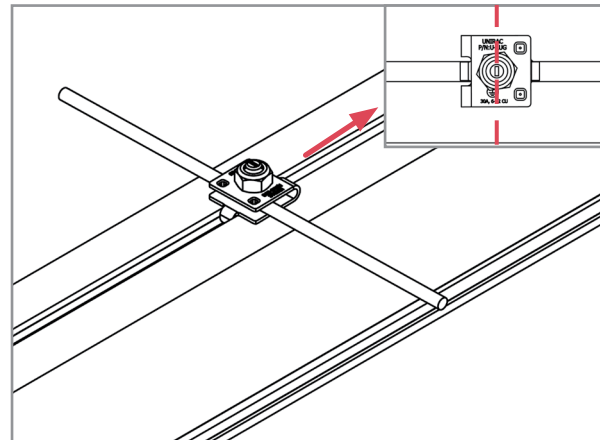

ALIGN POSITION INDICATOR

- Verify that the position indicator on the bolt is perpendicular to the rail.

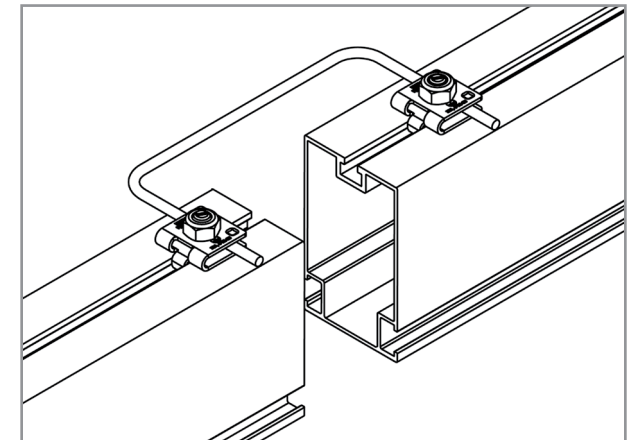


TO ESTABLISH EAST-WEST BONDING

- Place a Grounding Lug at one end of the rail, closer to the adjacent rail end
- Insert the grounding wire into the Grounding Lug and tighten the 1/4" nut to secure both the Grounding Lug and the wire to the rail


Torque the 1/4" nut to 10 ft-lbs.

NOTE: 1.Follow the above instructions when attaching the Grounding Lug to the SM Rail.
2.The Grounding Lug is single use only.


Torque the 1/4" nut to 10 ft-lbs.

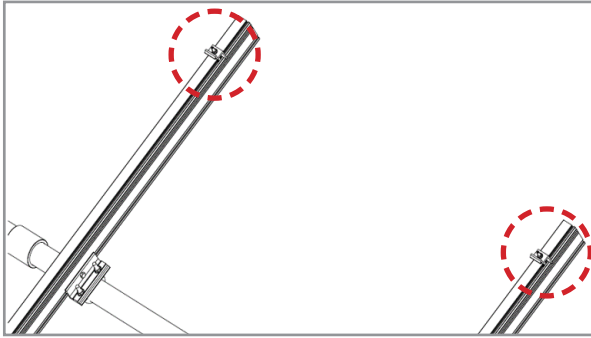

INSTALL MODULE ENDCLAMPS: The Endclamp is supplied as an assembly with a T-bolt, serrated flange nut, and washer. The washer retains the clamp at the top of the assembly. This will enable the clamp to remain upright for module installation.

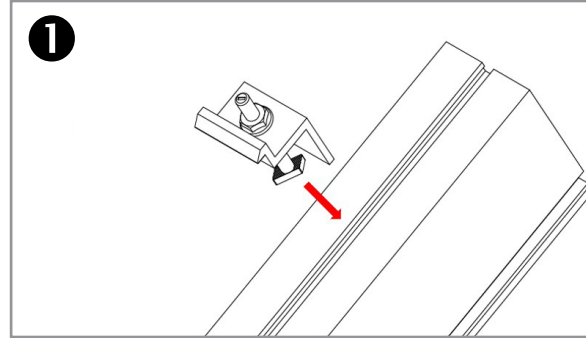


1
INSERT ENDCLAMP T-BOLT: Insert 1/4" T-bolt into rail.

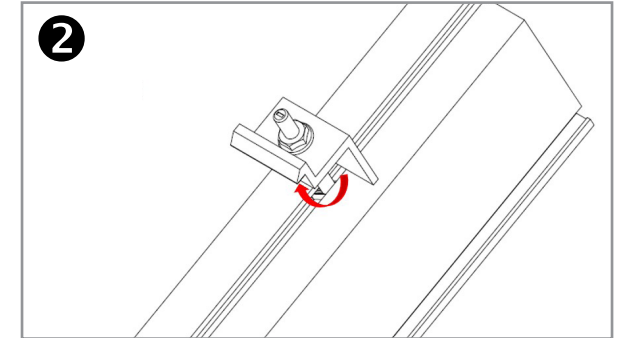


2
ROTATE ENDCLAMP T-BOLT: Rotate T-bolt into position. Verify that the position indicator & T-bolt shaft are angled in the correct position.

End clamps are positioned on rails prior to the first end module and installed after the last end module.

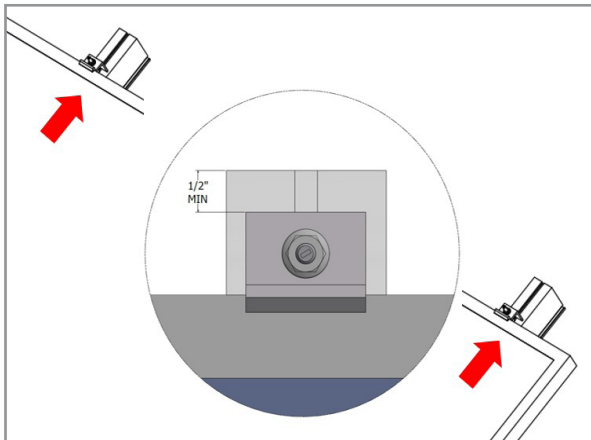


INSTALL FIRST MODULE: Install the first end module onto rails. Engage module frame with Endclamps. Verify that the position indicator & T-bolt shaft are angled in the correct position.

TORQUE VALUE 1/4" nuts to 10 ft-lbs. w/Anti Seize

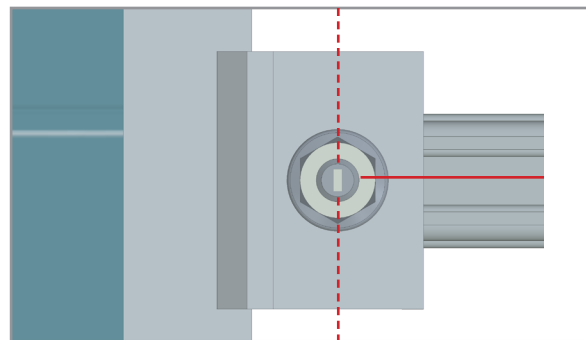


POSITION INDICATOR - SERRATED T-BOLT: Verify the T-bolt position indicator is perpendicular to the rail.


NOTE: *See appendix for additional clamp configurations

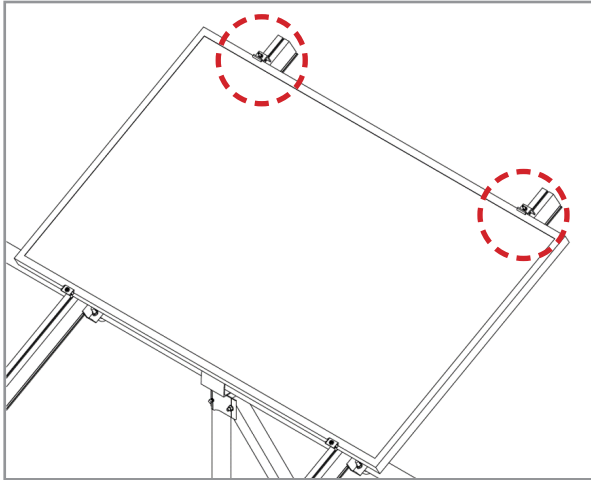


INSTALL MIDCLAMPS: Midclamp is supplied as an assembly with a T-bolt for module installation. Clamp assemblies may be positioned in rail near point of use prior to module placement.

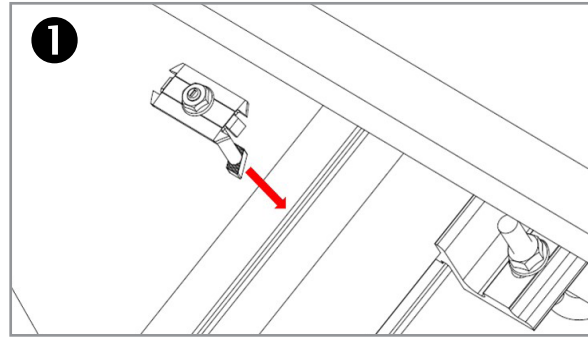

INSERT MIDCLAMP T-BOLT: Apply Anti-Seize and insert 1/4" T-bolt into rail.

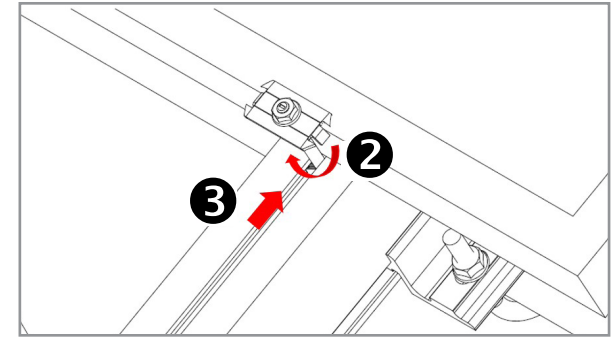


ROTATE MIDCLAMP T-BOLT: Rotate bolt into position and slide until bolt and clamp are against module frame. Do not tighten nut until next module is in position. Verify that the position indicator & T-bolt shaft are angled in the correct position.

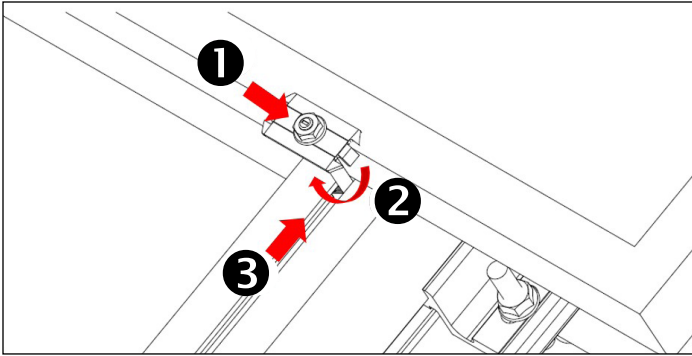

INSTALL REMAINING MID-CLAMPS:

Proceed with module installation. Engage each module with previously positioned Midclamp assemblies.

NOTE: Apply Anti-Seize to each Mid Clamp prior to installation.

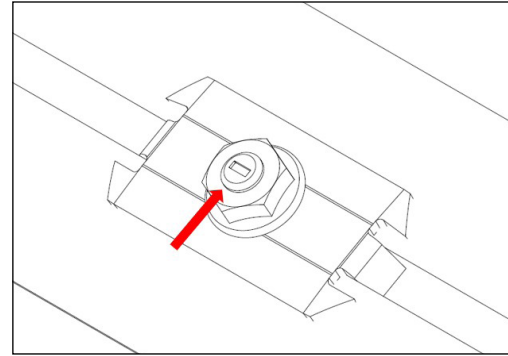


POSITION T-BOLT ALIGNMENT MARKS:

Verify that the position indicator(s) & T-bolt shaft(s) are angled in the correct position.

TORQUE VALUE

1/4" nuts to 10 ft-lbs. w/Anti Seize

Trim installation Instructions

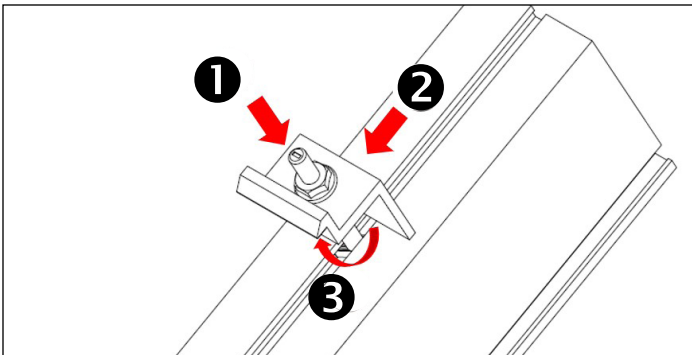


INSTALL ENDCLAMPS:

Apply Anti-Seize and install final Endclamps in same manner as first Endclamps. Slide clamps against module.


TORQUE VALUE

1/4" nuts to 10 ft-lbs. w/Anti Seize

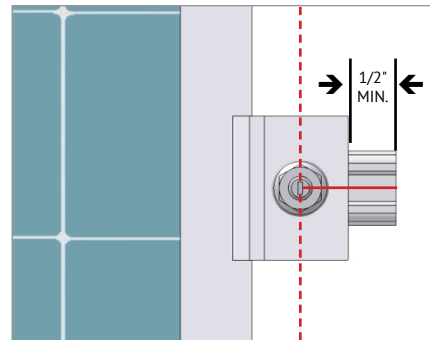


POSITION T-BOLT ALIGNMENT MARKS & CUT RAIL:

Verify that the position indicator(s) & T-bolt shaft(s) are angled in the correct position. Trim off any excess rail, being careful not to cut into the roof. Allow 1/2" between the Endclamp and the end of the rail.

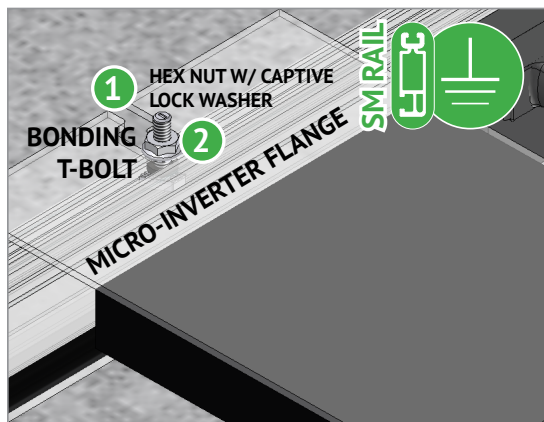


BONDING MICROINVERTER MOUNT

- 1 Hex nut with captive lock washer bonds metal microinverter flange to stainless steel T-bolt.
- 2 Serrated T-bolt head penetrates rail anodization to bond T-bolt, nut, and L-foot to grounded SM rail

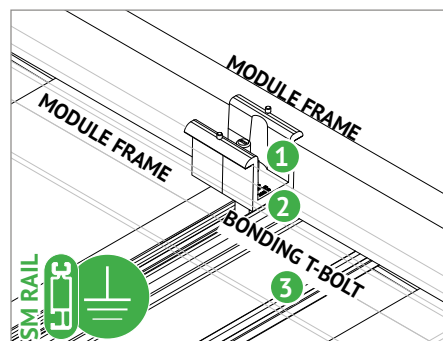

BONDING MIDCLAMP ASSEMBLY


- 1 Aluminum mid clamp with stainless steel bonding pins that pierce module frame anodization to bond module to module through clamp.
- 2 Stainless steel nut bonds aluminum clamp to stainless steel T-bolt
- 3 Serrated T-bolt head penetrates rail anodization to bond T-bolt, nut, clamp, and modules to SM rail

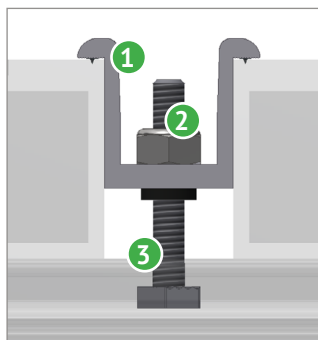


RACK SYSTEM GROUND

- 1 WEEB washer dimples pierce anodized rail to create bond between rail and lug
- 2 Solid copper wire connected to lug is routed to provide final system ground connection.

NOTE: IlSCO lug can also be used when secured to the side of the rail.

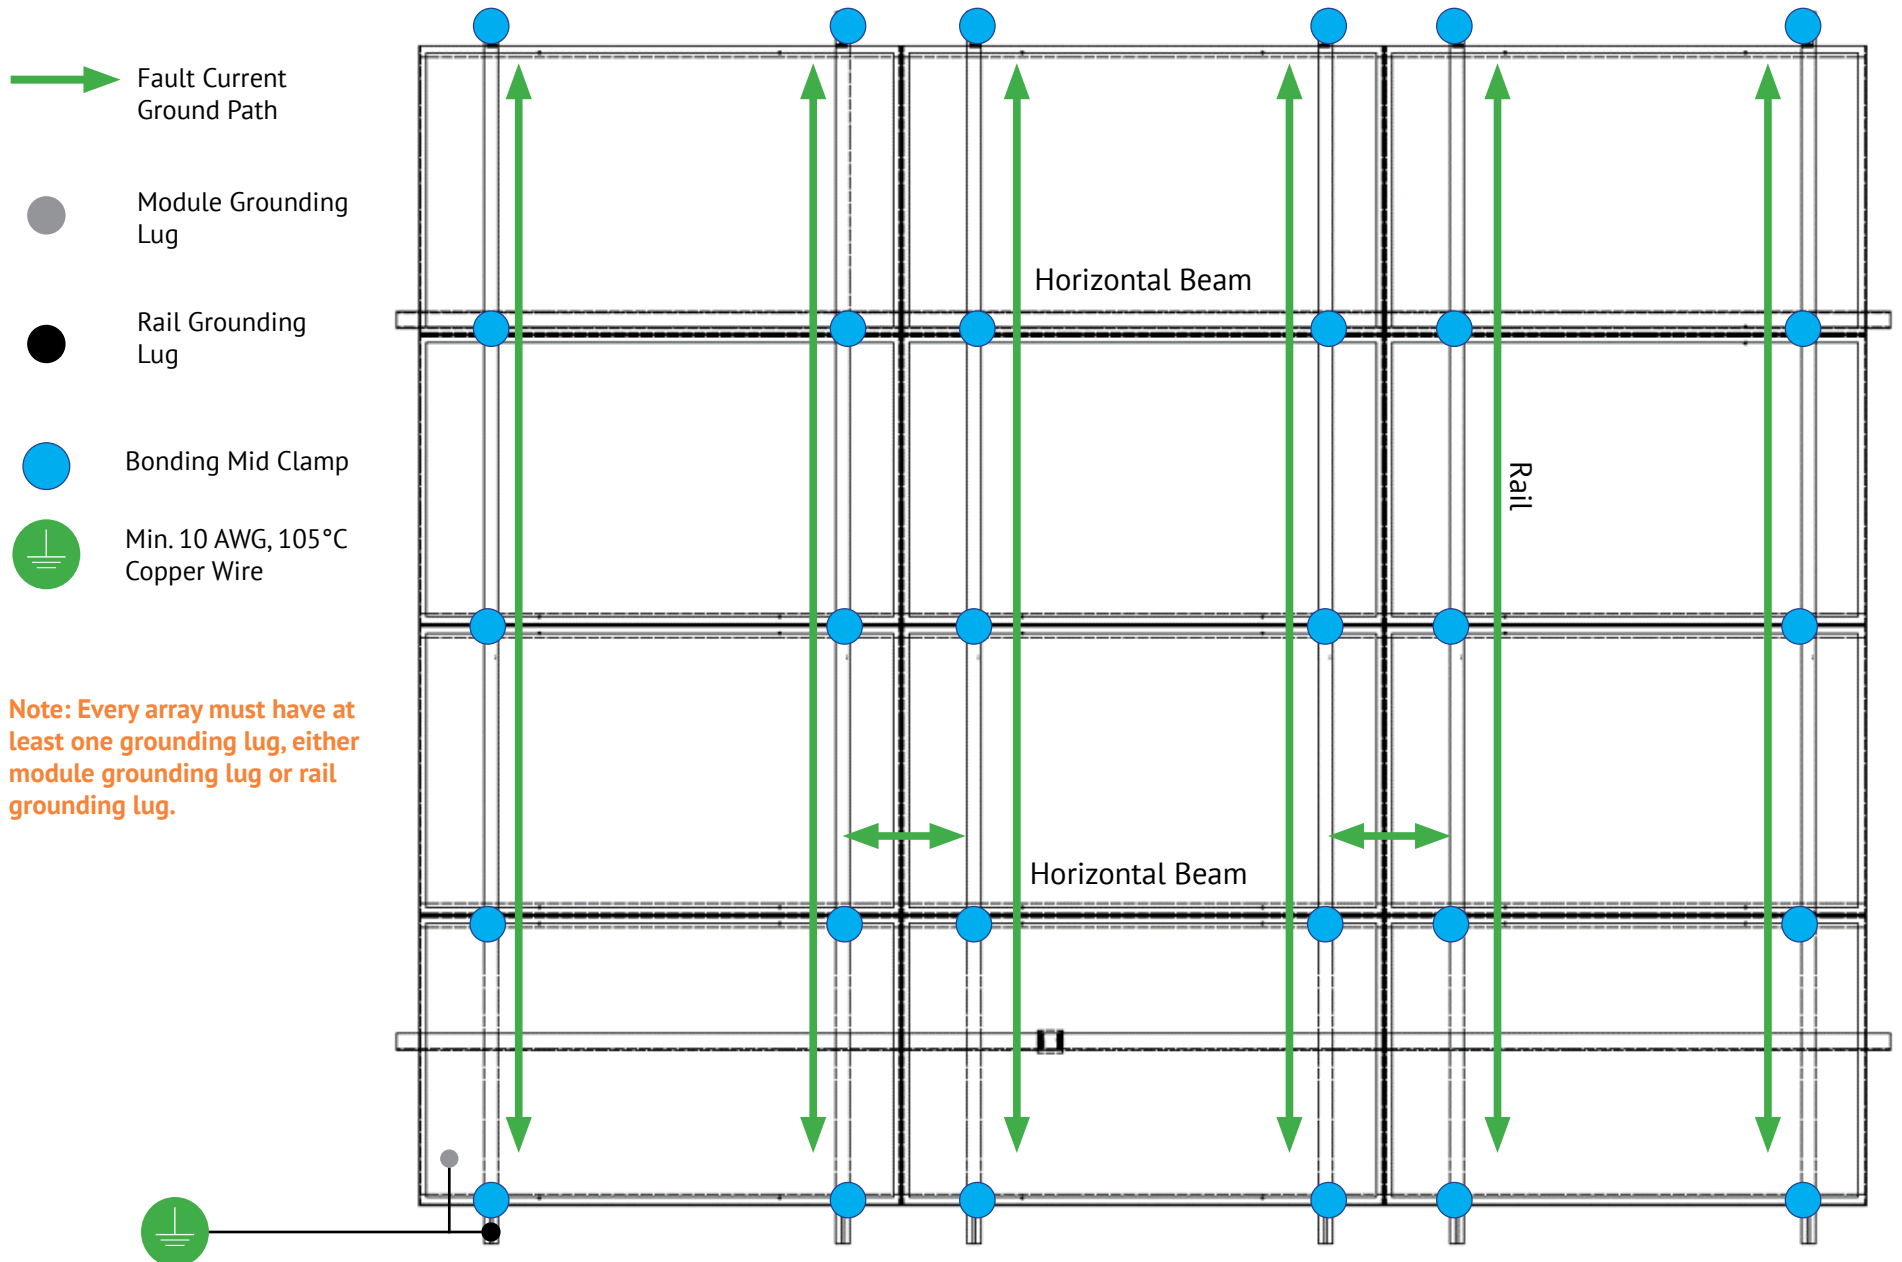

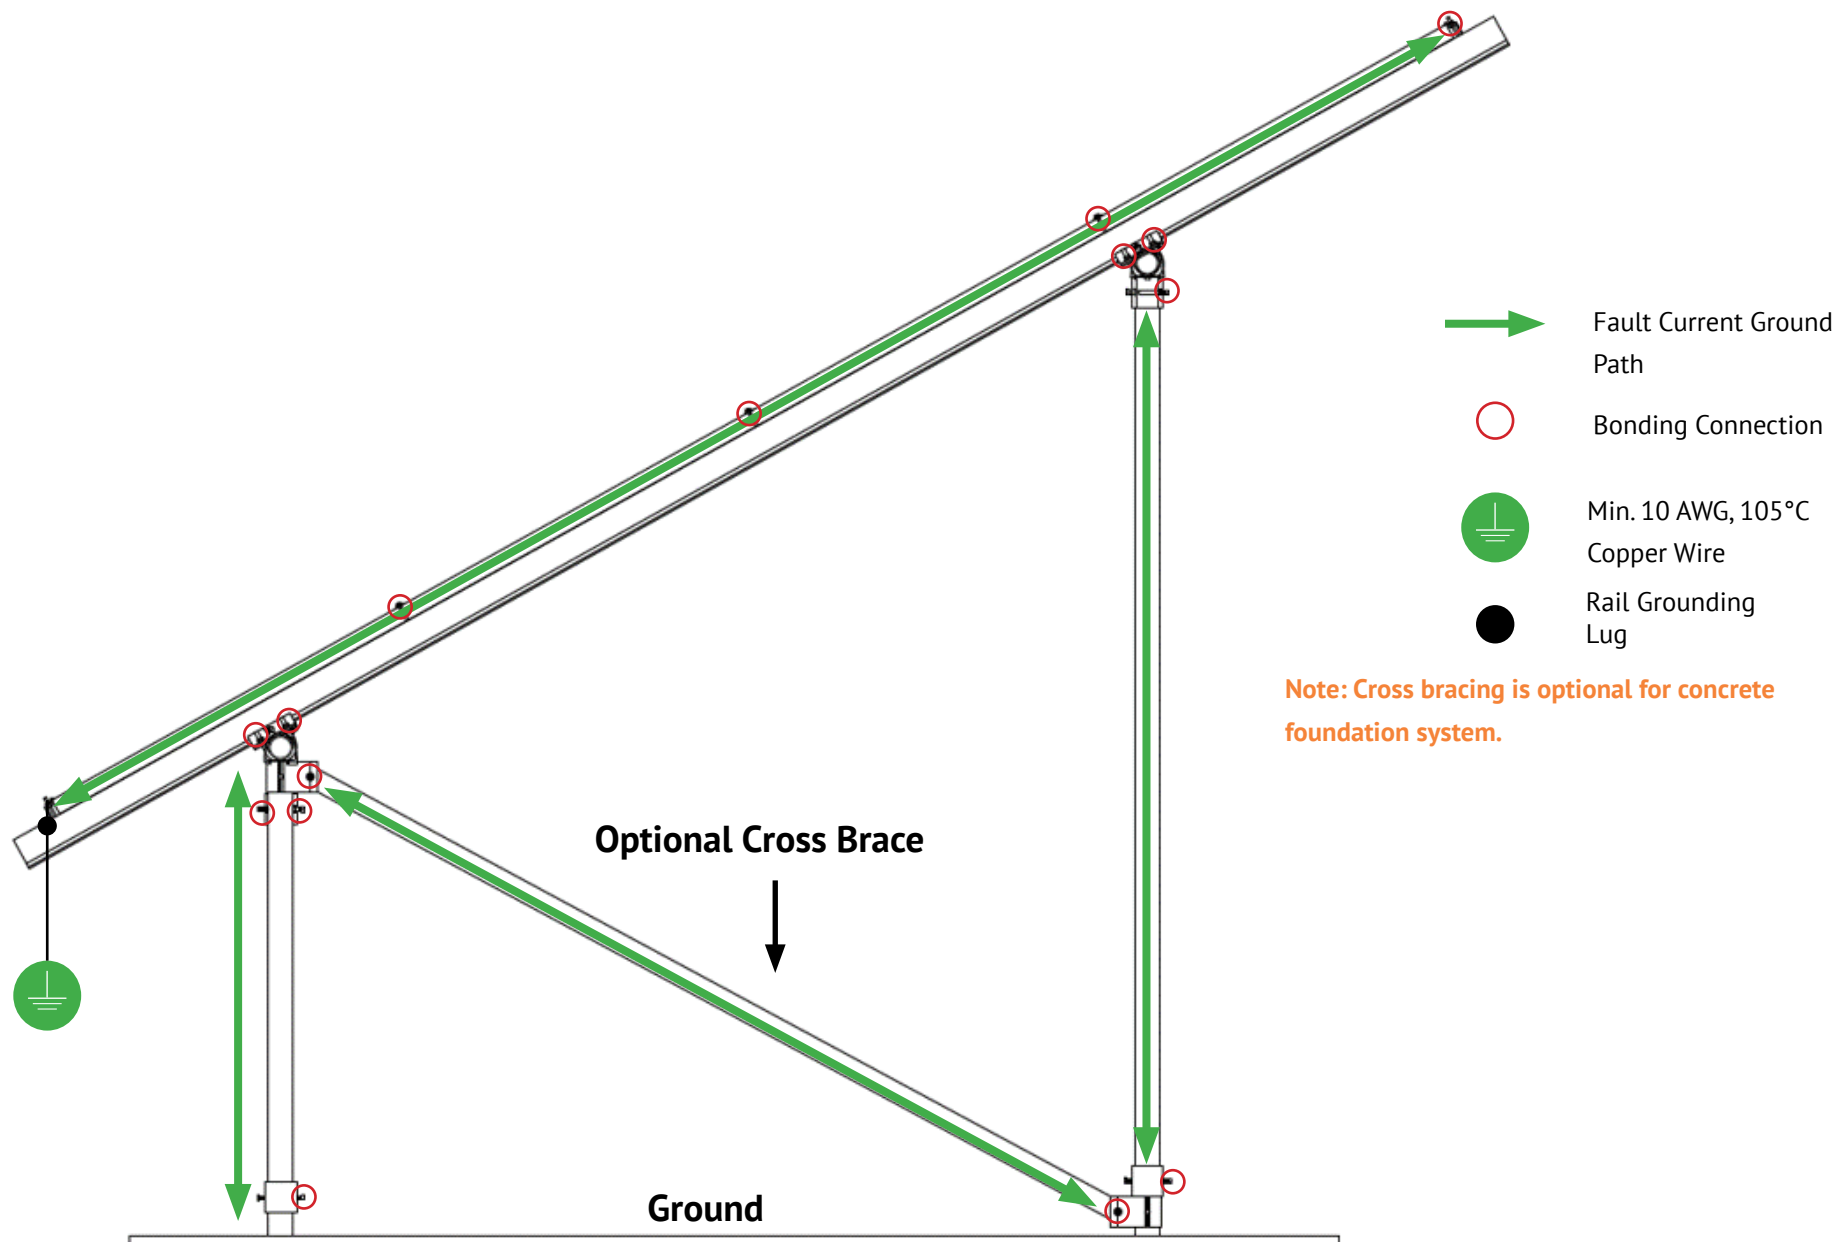



UL2703 CERTIFICATION MARKING LABEL Unirac ULA is listed to UL 2703. Certification marking is embossed on all mid clamps as shown. Marking Labels are shipped with the Mid clamps. After the racking system is fully assembled, a single Marking Label should be applied to the rail at the edge of the array. Before applying the label, the corners of the label that do not pertain to the system being installed must be removed so that only the installed system type is showing. Note: The sticker label should be placed such that it is visible, but not outward facing.

PERIODIC INSPECTION

Conduct periodic inspections for loose components, loose fasteners or any corrosion.
Any components showing signs of damage that compromise safety shall be replaced immediately.

The ULA system has been certified and listed to the UL 2703 standard (Rack Mounting Systems and Clamping Devices for Flat-Plate Photovoltaic Modules and Panels). This standard included electrical grounding, electrical bonding and mechanical load testing.

In conducting these tests, specific modules are selected for their physical properties so that the certifications can be broadly applied. The following lists the specific modules that were tested and the applicability of those certifications to other modules that might come onto the market.

In addition to UL 2703 certification, Unirac performs internal testing beyond the requirements of certification tests in order to establish system functional limits, allowable loads, and factors of safety. These tests include functional system tests, and destructive load testing.

Mechanical Load Test Modules																	
The modules selected for UL 2703 mechanical load testing were selected to represent the broadest range possible for modules on the market. The tests performed cover the following basic module parameters: • Frame thicknesses greater than or equal to 1.0 mm • Basic single and double wall frame profiles (some complex frame profiles could require further analysis to determine applicability) • Clear and dark anodized aluminum frames • PV modules may have a reduced load rating, independent of the ULA load rating. Please consult the PV module manufacturer's installation guide for more information.	<table><tr><th colspan="4">Tested Modules</th></tr><tr><th>Module Manufacturer</th><th>Model/Series</th><th>Area [sqft]</th><th>UL2703 Certification Load Ratings</th></tr><tr><td>First Solar</td><td>FS-6xxx-P</td><td>27.12</td><td>Down – 33.9 PSF, Up – 33.9 PSF Down-Slope – 16.5 PSF</td></tr><tr><td>Trina</td><td>TSM-DEG21C.20</td><td>33.43</td><td>Down: 27.79 PSF, Up: 28.05 PSF, Down-Slope: 9.8 PSF</td></tr></table>	Tested Modules				Module Manufacturer	Model/Series	Area [sqft]	UL2703 Certification Load Ratings	First Solar	FS-6xxx-P	27.12	Down – 33.9 PSF, Up – 33.9 PSF Down-Slope – 16.5 PSF	Trina	TSM-DEG21C.20	33.43	Down: 27.79 PSF, Up: 28.05 PSF, Down-Slope: 9.8 PSF
Tested Modules																	
Module Manufacturer	Model/Series	Area [sqft]	UL2703 Certification Load Ratings														
First Solar	FS-6xxx-P	27.12	Down – 33.9 PSF, Up – 33.9 PSF Down-Slope – 16.5 PSF														
Trina	TSM-DEG21C.20	33.43	Down: 27.79 PSF, Up: 28.05 PSF, Down-Slope: 9.8 PSF														

Tested Modules			
Module Manufacturer	Model/Series	Area [sqft]	UL2703 Certification Load Ratings
Hyundai	HiS-S325TI	21.06	Down– 113 PSF, Up – 50 PSF Down-Slope – 15 PSF
SunPower	SPR-P19-395-COM	22.20	Down– 113 PSF, Up – 50 PSF Down-Slope – 15 PSF

Note:

- Please refer U-Builder engineering report or stamped engineering package for information on mechanical load ratings, spans and cantilevers.
- Load ratings mentioned above are applicable for modules on table not on substructure.

Electrical Bonding and Grounding Test Modules

The list below is not exhaustive of compliant modules but shows those that have been evaluated and found to be electrically compatible with the UNIRAC LARGE ARRAY system.

Manufacture	Module Model / Series
Aleo	P-Series & S-Series
AMPS	AMPS-xxxN-108BB AMPS-xxxP-54BB
Aptos Solar	DNA-108-(MF/BF)10-xxxW DNA-120-(MF/BF)10-xxxW DNA-120-(MF/BF)23 DNA-120-(MF/BF)26 DNA-144-(MF/BF)23 DNA-144-(MF/BF)26 DNA-144-BF10-xxxW-DG
Astronergy	ASM6612P Series CHSM6612 M, M/HV CHSM6612P/HV Series CHSM6612P Series CHSM66M(DG)/F-BH CHSM72M(DG)/F-BH CHSM72M-HC CHSM72N(DG)/F-BH
Auxin	AXN10Mxxx AXN6M610T, AXN6M612T AXN6P610T, AXN6P612T AXNG1M SERIES
Axitec	AC-xxx(M/P)/60S, AC-xxx(M/P)/72S AC-xxxMH/120(S/V/SB/VB) AC-xxxMH/144(S/V/SB/VB) AC-xxxP/156-60S AC-xxxTGB/108BB AC-xxxTGB/144TS AC-xxxTGB/144WS-US AC-xxxTGB/96BB

Manufacture	Module Model / Series
Bluesun Solar	HEX5 BSMxxxM10-54HPH BSMxxxM10-72HBD
Boviet Solar	BVM6610 BVM6610M-xxxS-H-HC BVM6610M-xxxS-H-HC-BF BVM6612 BVM6612M-XXXS-H-HC-BF-DG BVM7612M-H-HC-BF-DG
BYD	P6K & MHK-36 Series
Canadian Solar	CS1(H/K/U/Y)-MS CS3K-(MB/MB-AG/MS/P/P HE/PB-AG) CS3L-(MS/P) CS3U-(MB/MB-AG/MS/P/P HE/PB/PB-AG) CS3W-(MS/P/P-PB-AG) CS3W-MB-AG CS3Y-MB-AG CS5A-M CS6.1-54TM-H CS6.1-60TM-H CS6.1-72TB-H CS6.2-48TM-xxxH CS6.2-66TB-xxxH CS6.2-66TB-xxxHR CS6K-(M/MS/MS AllBlack/P/P HE) CS6P-(M/P) CS6R-MS-HL CS6R-xxxMS-HL CS6U-(M/P/P HE) CS6W-MB-AG CS6W-MS CS6W-xxx-TB-AG CS6X-P CS7L-MB-AG CS7L-TB-AG CS7N-xxxMB-AG

Manufacture	Module Model / Series
Canadian Solar (Cont.)	CS7N-xxx MS CS7N-xxxTB-AG CSX-P ELPS CS6(A/P)-MM
Centrosolar America	C-Series & E-Series
CertainTeed	CT2xxMxx-01, CT2xxPxx-01, CTxxxMxx-01, CTxxxPxx-01, CTxxxMxx-02, CTxxxMxx-03 CT54M10XXX-N07 CT72M10XXX-N07 CTM10400HC11-06 , CTxxxHC11-06 CTM10400HC11-08, CTM10400HC11-09 CTTCxxxHC12-08 CTxxxMxx-04, CTxxxHC11-04
Eco Solargy	Orion 1000 & Apollo 1000
EMMVEE	ExxxHCBG144-T ExxxHCBT144-T ExxxH CM120-B ExxxM72-B ExxxP72-B Titanium Clear Titanium Duo
Energy America	ZLK-xxx
ET Solar	ET AC Module, ET Module, ET-M772BH520-550WW/WB ET-M772BHxxxTW/TB ET-N772TBHxxxGL
Fellow Energy	FE72-18X(ND)
Flextronics	FXS-xxxBB
Freedom Forever	FF-MP-BBB-xxx, FF-MP1-BBB-xxx
GCL	GCL-P6 & GCL-M6 Series

The modules selected for UL 2703 bonding and grounding testing represent the broadest possible range of modules on the market. The tests were performed for each specific bonding location using representative module frame profile sections. The tests performed cover the following basic module parameters:

- The frame profile must not have any feature that might interfere with the bonding devices that are integrated into the racking system
- Use with a maximum over current protection device OCPD of 30A
- Unless otherwise noted, all modules listed above include all wattages and specific models within that series. Variable wattages are represented as "xxx"
- Items in parenthesis are those that may or may not be present in a compatible module's model ID
- Slashes "/" between one or more items indicates that either of those items may be the one that is present in a module's model ID

Electrical Bonding and Grounding Test Modules

The list below is not exhaustive of compliant modules but shows those that have been evaluated and found to be electrically compatible with the UNIRAC LARGE ARRAY system.

Manufacture	Module Model / Series
Gstar Solar	GSD7S54T-xxxBT GSP7G54M(H)
Hansol	TD-AN3, TD-AN4, UB-AN1, UD-AN1
Hanwha SolarOne	HSL 60
Heliene	36M, 36P 60M, 60P, 72M & 72P Series, 132HC M10 SL Monofacial 144HC M10 NTYP SL Bifacial 144HC M10 SL Bifacial 156HC M10 NTYP SL Bifacial 156HC M10 SL Bifacial
HT-SAAE	HT72-18X(ND)-F
HT Solar	HT72-156(M/P), HT72-156P-C, HT72-156P(V)-C HT72-156M(PDV)-BF, HT72-156M(PD)-BF, HT72-166M, HT72-18X, HT60-156M-C, HT60-156M(V)-C
Hyperion Solar	HY-DH108N8B HY-DH108P8(B) HY-DH144P8 HY-DH156N8 HY-DH156P8
Hyundai	KG, MG, RW, TG, RI, RG, TI, KI, HI Series HiA-SxxxHG HiD-SxxxRG(BK) HiN-SxxxXG(BK) HiN-TxxxNF(BK) HiN-TxxxNI HiN-TxxxNJ HiN-TxxxOJ HiS-S400PI

Manufacture	Module Model / Series
Hyundai(Cont.)	HiS-SxxxGI HiS-SxxxOJ HiS-SxxxXG(BK) HiS-SxxxYH(BK) HiS-TxxxNF(BK) HiS-TxxxNJ
Illuminate USA	IL5-72HBD-xxx M IL8-66HGD-xxx M
Imperial Star	ISM7-SHDD108-400/M
INDEPWR Solar	iPWR-M10-54BX2S-xxxW iPWR-M10-60BX2S-xxxW
ITEK	iT-SE Series
Japan Solar	JPS-60 & JPS-72 Series
JA Solar	JAP72S##-xxx/** JAP6(k)-60-xxx/4BB, JAP60S##-xxx/** JAM6(k)-72-xxx/**, JAM72S##-xxx/** JAM6(k)-60-xxx/**, JAM60S##-xxx/** i. ##: 01, 02, 03, 09, 10 ii. **: SC, PR, BP, HiT, IB, MW ** = Backsheet, ## Cell technology JAM54D41-xxx/MB JAM54S30 xxx/MR JAM54S31 xxx/MR JAM6(K)-60/xxx JAM66D45 LB JAM72D10 xxx/MB JAM72D40 xxx/MB JAM72S30 /MR JAP6(k)-72-xxx/4BB JAP6 60-xxx

Manufacture	Module Model / Series
Jinko	JKM & JKMS Series JKMxxxM-6RL3-B JKMxxxM-72HBL-V JKMxxxM-72HL4-TV JKMxxxM-72HLM-TV JKMxxxM-72HL-V JKMxxxM-7RL3-TV JKMxxxN-54HL4-B JKMxxxN-72HL4-BDV (30mm & 35mm Frame Height) JKMxxxN-72HL4-BDX JKMxxxN-72HL4-TV
Kyocera	KD-F & KU Series
LA Solar	BLA Model LSxxxBF LSxxxBL LSxxxBL (410 watt) LSxxxHC LSxxxHC (430-450 watt range)
LG Electronics	LGxxx(E1C/E1K/N1C/N1K/N2T/N2W/S1C/ S2W/Q1C/Q1K)-A5 LGxxx(A1C/M1C/M1K/N1C/N1K/Q1C/Q1K/ QAC/QAK)-A6, LGxxxN2W-B3, LGxxx- N2T-B5, LGxxxN1K-B6, LGxxx(N1C/N1K/N2T/ N2W)-E6 LGxxx(N1C/N1K/N2W/S1C/S2W)-G4 LGxxxN2T-J5, LGxxx(N1K/N1W/N2T/ N2W)-L5 LGxxx(M1C/N1C/Q1C/Q1K)-N5 LGxxx(N1C/N1K/N2W/Q1C/Q1K)-V5

The modules selected for UL 2703 bonding and grounding testing represent the broadest possible range of modules on the market. The tests were performed for each specific bonding location using representative module frame profile sections. The tests performed cover the following basic module parameters:

- The frame profile must not have any feature that might interfere with the bonding devices that are integrated into the racking system
- Use with a maximum over current protection device OCPD of 30A
- Unless otherwise noted, all modules listed above include all wattages and specific models within that series. Variable wattages are represented as "xxx"
- Items in parenthesis are those that may or may not be present in a compatible module's model ID
- Slashes "/" between one or more items indicates that either of those items may be the one that is present in a module's model ID

Electrical Bonding and Grounding Test Modules

The list below is not exhaustive of compliant modules but shows those that have been evaluated and found to be electrically compatible with the UNIRAC LARGE ARRAY system.

Manufacture	Module Model / Series
LONGi	LR4-60(HPB/HPH)
	LR4-72(HBD/HPH)
	LR4-72HBD xxxM
	LR5-54HABB-xxx M (fire type 29 only)
	LR5-54HABB-xxx M (fire type 38 only)
	LR5-54-HPB-xxx M
	LR5-54HTB xxxM
	LR5-72HBD xxx M
	LR6-60
	LR6-60(BK/HPB/HPH/HV/PB/PE/PH)
	LR6-72
	LR6-72(BK/HBD/HV/PB/PE/PH)
	LR7-54HGBB-xxx M
	LR7-72HGD-xxx M
	LR8-54HGBB
	LR8-66HGD-xxx M
Maxeon	SPR-MAX3-xxx-BLK-R
	SPR-MAX3-xxx-COM
	SPR-MAX3-xxx-R
	SPR-MAX6-xxx
	SPR-MAX6-xxx-BLK
Meyer Burger	Meyer Burger Black
	Meyer Burger White
	Meyer Burger Glass

Manufacture	Module Model / Series
Mission Solar Energy	MSE Mono, MSE Perc
	MSExxxHT0B
	MSExxxSR(8T/8K/9S),
	MSExxxSX(5T/5K/6W)
	MSExxxSX6Z
	MSExxxSX9R
	MSExxxSX9Z
	MSH10-xxxHN4G
	MSH10-xxxHT4T
	MSI10-xxxHN4G
	MSI10-xxxHT4G
	MSI10-xxxHT4T
Mitrex	MSN10xxxHT4T
	MSX10-xxxHN0B
Mitrex	Mxxx-L3H, Mxxx-I3H
Mitsubishi	MJE & MLE Series
mSolar	108BB HC Series (TXI10-xxx108BB)
	144BB HC Series (TXS6-xxx144BB)
Neo Solar Power Co.	D6M Series
	NESE xxx-72MHB-M10
NE Solar	NESE xxx-60MH-M6
	NESE xxx 66MHB-G12
	NESE xxx 72MHB-M10
	NESE xxx 72MHT-M10
	NESE xxx 72THB-M10
Panasonic	VBHNxxxSA06/SA06B/SA11/SA11B
	VBHNxxxSA15/SA15B/SA16/SA16B,
	VBHNxxxKA, VBHNxxxKA03/04,
	VBHNxxxSA17/SA17G/SA17E/SA18/SA18E,
	VBHNxxxZA01/ZA02/ZA03/VBHNxxxZA04,
	EVVxxx, EVVxxx(H/K/PK/HK/HK2)

Manufacture	Module Model / Series
Peimar	SGxxxM (FB/BF) SMxxxM
Philadelphia Solar	PS-M108(HCBF)-400W (30 & 35mm frames)
	PS-M144(HCBF)-xxxW
	PS-MNB108(HCBF)-xxxW
	PS-MNB144(HCBF)-xxxW
	PS-MNB156(HCBF)-xxxW
Phono Solar	PSxxxM1-20/U
	PSxxxM1H-20/U
	PSxxxM1-20UH
	PSxxxM1H-20UH
	PSxxxM1-20/UH
	PSxxxM1H-20/UH
	PSxxxM-24/T
	PSxxxMH-24/T
	PSxxxM4(H)-24/TH
	PSxxxM-24/TH
Prism Solar	PSxxxMH-24/TH
Prism Solar	P72 Series, P72X-xxx

The modules selected for UL 2703 bonding and grounding testing represent the broadest possible range of modules on the market. The tests were performed for each specific bonding location using representative module frame profile sections. The tests performed cover the following basic module parameters:

- The frame profile must not have any feature that might interfere with the bonding devices that are integrated into the racking system
- Use with a maximum over current protection device OCPD of 30A
- Unless otherwise noted, all modules listed above include all wattages and specific models within that series. Variable wattages are represented as "xxx"
- Items in parenthesis are those that may or may not be present in a compatible module's model ID
- Slashes "/" between one or more items indicates that either of those items may be the one that is present in a module's model ID

Electrical Bonding and Grounding Test Modules

The list below is not exhaustive of compliant modules but shows those that have been evaluated and found to be electrically compatible with the UNIRAC LARGE ARRAY system.

Manufacture	Module Model / Series
Q Cells	Plus, Pro, Peak, G3, G4, Peak G5(SC) , G6(+)(SC)(AC), G7, G8(+) Plus, Pro, Peak L-G2, L-G4, L-G5 Peak L-G5, L-G6, L-G7, L-G8(BFF) Q.PEAK DUO(BLK)-G6+ Q.PEAK DUO (BLK)-G7 Q.PEAK DUO (BLK) G8(+) Q.PEAK DUO (BLK) ML-G10(+) Q.PEAK DUO (BLK) ML-G10.a(+) Q.PEAK DUO (BLK) ML-G9(+) Q.PEAK DUO BLK G10(+) Q.PEAK DUO BLK G10+ /AC Q.PEAK DUO BLK-G6+/TS Q.PEAK DUO BLK ML-G10+ Q.PEAK DUO BLK ML-G10+/AC Q.PEAK DUO BLK ML-G10.B+ Q.PEAK DUO BLK ML-G10.C+ Q.PEAK DUO BLK ML-G10.C1+/AC Q.PEAK DUO BLK ML-G10+ / t Q.PEAK DUO BLK ML-G10+ / TS Q.PEAK DUO-G10+ Q.PEAK DUO G10.C1+ AC Q.PEAK DUO L-(G7/G7.1/G7.2/G7.3/G7.7) Q.PEAK DUO L-(G8/G8.1/G8.2/G8.3) Q.PEAK DUO L-G6.3 / BFG Q.PEAK DUO ML-G12S.3/BFG Q.PEAK DUO ML-G12S.7/BFG Q.PEAK DUO ML-G12S.d / BFG Q.PEAK DUO XL-(G10/G10.2/G10.3/G10.c/ G10.d) Q.PEAK DUO XL-(G11.2/G11.3) Q.PEAK DUO XL-(G9/G9.2/G9.3) Q.PEAK DUO XL-G10.3/BFG Q.PEAK DUO XL-G10.d/BFG

Manufacture	Module Model / Series
Q Cells (cont.)	Q.PEAK DUO XL-G11.3/BFG Q.PEAK DUO XL-G11S.3 / BFG Q.PEAK DUO XL-G9.3 BFG Q.TRON BLK M-G2+ Q.TRON BLK M-G2.(H1).(F1).(C1)+/AC Q.TRON BLK M-G2+ AC Q.TRON BLK M-G2.C+ Q.TRON BLK M-G2.F+ Q.TRON BLK M-G2.F1+/AC Q.TRON BLK M-G2.H+ Q.TRON BLK M-G2.H1+/AC. Q.TRON BLK M-G2+ SERIES Q.TRON M-G2+ SERIES Q.TRON ML-G3.3/BFG Q.TRON XL-G2.3/BFG Q.PEAK DUO BLK ML-G10.XY+/AC (where "X" = any letter between A to W, where "Y" = any number between 1 to 9.)
REC	RECxxxAA (BLK/Pure/Pure-R/ Pure-RX/ Pure 2/ Pro M) RECxxxAA Pure-RX RECxxxNP (N-PEAK) RECxxxNP2 (Black) RECxxxNP3 Black RECxxxPE RECxxxPE72 RECxxxTP RECxxxTP2(M/BLK2) RECxxxTP2S(M)72 RECxxxTP3M (Black) RECxxxTP4 (Black) RECxxxTP72
Renesola	All 60-cell modules RS6-xxxNBG-E3

Manufacture	Module Model / Series
Risen	RSM Series RSM110-8-xxxBMDG
SEG Solar	SEG-xxx-BMD-HV SEG-xxx-BMD-TB SEG-XXX-BMB-TB SEG-xxx-BMA-HV, SEG-xxx-BMA-TB SEG-xxx-BMB-HV, SEG-xxx-BMA-BG SEG-xxx-BMB-BG, SEG-xxx-BTA-BG SEG-xxx-BTB-BG, SEG-xxx-BMD-BG SEG-xxx-BTD-BG
S-Energy	SL40-60MAI/MBI/MCI-xxxV SL45-60BGI/BHI SL45-60MBI-xxxZ SN72 & SN60 Series
Seraphim	SEG-(6PA/6PB/6MA/6MA-HV/6MB/E01/ E11) SRP-(6QA/6QB) SRP-xxx-6MB-HV SRP-xxx-BMA-HV SRP-xxx-BMB-HV SRP-xxx-BMC-HV SRP-xxx-BMD-HV SRP-xxx-BMD-HV SRP-xxx-BMZ-HV SRP-xxx-BTA-BG SRP-xxx-BTB-BG SRP-xxx-BTC-BG SRP-xxx-BTD-BG SRP-xxx-BTE-BG
Sharp	NU-SA & NU-SC Series

The modules selected for UL 2703 bonding and grounding testing represent the broadest possible range of modules on the market. The tests were performed for each specific bonding location using representative module frame profile sections. The tests performed cover the following basic module parameters:

- The frame profile must not have any feature that might interfere with the bonding devices that are integrated into the racking system
- Use with a maximum over current protection device OCPD of 30A
- Unless otherwise noted, all modules listed above include all wattages and specific models within that series. Variable wattages are represented as "xxx"
- Items in parenthesis are those that may or may not be present in a compatible module's model ID
- Slashes "/" between one or more items indicates that either of those items may be the one that is present in a module's model ID

Electrical Bonding and Grounding Test Modules

The list below is not exhaustive of compliant modules but shows those that have been evaluated and found to be electrically compatible with the UNIRAC LARGE ARRAY system.

Manufacture	Module Model / Series
Silfab	SLA-M, SLA-P, SLG-M, SLG-P & BC Series SILxxx(BG/BK/BL/NL/NT/HL/HN/ML/NX/ NU/HC/HC+/HM/QD/QM) SIL-xxx XL SIL-xxx XM SIL-xxx XM+
Sirius	ELNSM54M-HC-BF Series ELNSM54M-HC Series ELNSM72M-HC Series ELNSM54M-HC-N
Solar4America	S4Axxx-108MH10BB, S4Axxx-72MH5BB S4Axxx-144MH10xxx, S4Axxx-144TH10xxx S4Axxx-144TH16xxx, S4Axxx-108MH10xxx S4Axxx-108TH10xxx
SolarEver USA	SE-166*83-xxxM-120N SE-182*91-xxxM-108N SE-182*105-xxxM-96-BD
Solaria	PowerXT-xxxR-(AC/PD/BD) PowerXT-xxxC-PD PowerXT-xxxR-PM (AC) PowerX-400R
Solar Space	SS8-54HDB-xxx-N SS8-54HD-xxx-N SS8-72HD-xxx-M SS8-72HD-xxx-N SSA-48HDB-xxx-N SSA-48HD-xxx-N SSA-54HDB-xxx-N SSA-54HD-xxx-N SS8-78HD-xxx-M SS9-66HD-xxx-N SSA-66HD-xxx-N
Solartech	STU HJT, STU PERC & Quantum PERC
SolarWorld	Sunmodule Protect, Sunmodule Plus/Pro

Manufacture	Module Model / Series
Sonali	SS-M-360 to 390 Series, SS-M-440 to 460 Series, SS-M-430 to 460 BiFacial Series, SS-M-390 to 400 Series.
Sun Edison	F-Series, R-Series
Suniva	MV Series & Optimus Series (35mm)
Sunmac Solar	M754SH-BB Series
SunPlus Optimum	SR4-54HTB-xxxM
SunPower	AC, X-Series, E-Series & P-Series, SPR-Mxxx-H-AC SPR-Mxxx-BLK-H-AC
Sunpro Power	SPDGxxx-120M12 SPDGxxx-N108M10 SPDGxxx-N144M10
Suntech	STP
Talesun	TP572, TP596, TP654, TP660, TP672, Hipor M, Smart TD6I72M
Talesun	TD7G72M TM3G48M TM3G54M TM3G66M TM7G54M TM7G60M TM7G72M TP6F72M TP6F72M(H) TP6L72M-450 TP7G54M(H)
Tata Power Solar	TPxxxHG10B

Manufacture	Module Model / Series
Tesla	SC, SC B, SC B1, SC B2, TxxxS Tesla Solar Panel TSP-415/TSP-420
Thornova	TS-BG54 TS-BG72 TS-BBT54(xxx) TS-BGT72(xxx)
TP Solar	TPxxxVG12R16NB
Trina Solar	PA05, PD05, DD05, DD06, DE06, DE09C.07 PD14, PE14, DD14, DE14, DE15 TSM-DE06X.05(II) TSM-DE09.05, TSM-DE09.08 TSM-DE09C.07 TSM-DE15H(II) TSM-DEG21C.20 TSM-NE09RC.05 TSM-NE09RH.05 TSM-NE19RC TSM-NED19RC.20 TSM-NEG19RC.20 TSM-NEG21C.20 TSM-NEG9RH.25
TSMC	TS-150C2 CIGSw
Universal Solar	UNI4xx-144BMH-DG UNI5xx-144BMH-DG UNIxxx-108M-BB UNIxxx-120M-BB UNIxxx-120MH
Upsolar	UP-MxxxP, UP-MxxxM(-B)

The modules selected for UL 2703 bonding and grounding testing represent the broadest possible range of modules on the market. The tests were performed for each specific bonding location using representative module frame profile sections. The tests performed cover the following basic module parameters:

- The frame profile must not have any feature that might interfere with the bonding devices that are integrated into the racking system
- Use with a maximum over current protection device OCPD of 30A
- Unless otherwise noted, all modules listed above include all wattages and specific models within that series. Variable wattages are represented as "xxx"
- Items in parenthesis are those that may or may not be present in a compatible module's model ID
- Slashes "/" between one or more items indicates that either of those items may be the one that is present in a module's model ID

Electrical Bonding and Grounding Test Modules


The list below is not exhaustive of compliant modules but shows those that have been evaluated and found to be electrically compatible with the UNIRAC LARGE ARRAY system.

Manufacture	Module Model / Series
URECO	D7Kxxx(H7A/H8A), D7Mxxx(H7A/H8A) F6MxxxE7G-BB FAKxxx(C8G/E8G), FAMxxxE7G-BB FAMxxxE8G(-BB) FBMxxxM7G-BB FBMxxxMFG-BB
Vikram Solar	Eldora, Somera, Ultima Paradea VSMDH.72.AAA.05
Vina	VNS-72M1-5-xxxW-1.5, VNS-72M3-5-xxxW-1.5, VNS-144M1-5-xxxW-1.5, VNS-144M3-5-xxxW-1.5, VNS-120M3-5-xxxW-1.0
VSUN	VSUN 4xx-144BMH VSUN4xx-144BMH-DG VSUN5xx-144BMH-DG VSUNxxx-108BMH VSUNxxx-108M-BB VSUNxxx-108MH VSUNxxx-120BMH VSUNxxx-120M-BB VSUNxxx-132BMH VSUNxxx-144BMH VSUNxxx-144M-BB VSUNxxx-144M-BW VSUNxxx-144MH VSUN xxx-60M-BB VSUNxxx-72MH VSUNxxxN-108BMH-BB VSUNxxxN-108BMH-BB (SoftPaw) VSUNxxxN-120BMH-BB (SoftPaw) VSUNxxxN-144BMH VSUNxxxN-144BMH-DG VSUNxxxN-144MH

Manufacture	Module Model / Series
Waaree	Ahnay Series Bi-33 Arka Series WSMDi Bi-55-xxx BiN-08-xxx
Winaico	WST & WSP Series
Yingli	YGE & YLM Series
Yotta Energy	YSM-B450-1
ZNShine	ZXM6-72 Series ZXM6-NH120 Series ZXM7-SH108 Series ZXM7-SHDB144 ZXM7-SHLDD144 ZXM7-UHLDD108 ZXM7-UHLDD144 ZXM8-GPLDD132 Series ZXM8-TPLDD132


The modules selected for UL 2703 bonding and grounding testing represent the broadest possible range of modules on the market. The tests were performed for each specific bonding location using representative module frame profile sections. The tests performed cover the following basic module parameters:

- The frame profile must not have any feature that might interfere with the bonding devices that are integrated into the racking system
- Use with a maximum over current protection device OCPD of 30A
- Unless otherwise noted, all modules listed above include all wattages and specific models within that series. Variable wattages are represented as "xxx"
- Items in parenthesis are those that may or may not be present in a compatible module's model ID
- Slashes "/" between one or more items indicates that either of those items may be the one that is present in a module's model ID

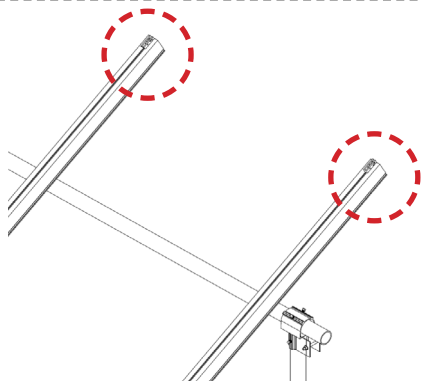


INSTALL MODULE END CLAMPS: The End clamp is supplied as an assembly with a 1/2" hex head bolt that is accessible at the ends of rails. The clamp should be installed on the rails prior to installing end modules.

1

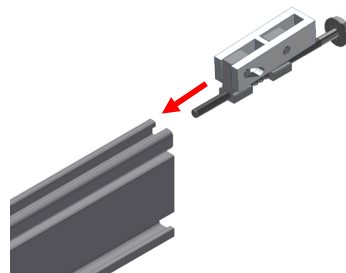


INSTALL END CLAMPS ON RAIL: Slide end clamp on to rail by engaging the two t-guide brackets with the top slot of the rails. **Ensure bolt is extended as far as possible so that clamp is positioned at max. distance from end of rail.**

2

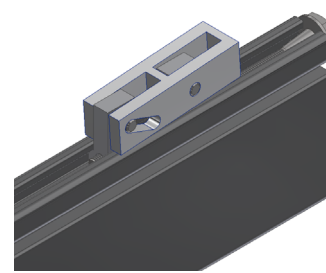


POSITION END CLAMPS: Slide end clamp assembly on to rail until bolt head engages with end of rail. **End clamps are positioned on rails prior to the first end module and prior to the last end module.**

3

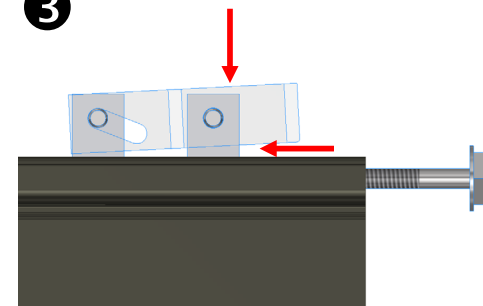


NOTE: To assist insertion of clamp into rail slot, Pressure may be applied to top or side of bracket as shown. Do not force clamp into rail by pushing on bolt with excessive force.

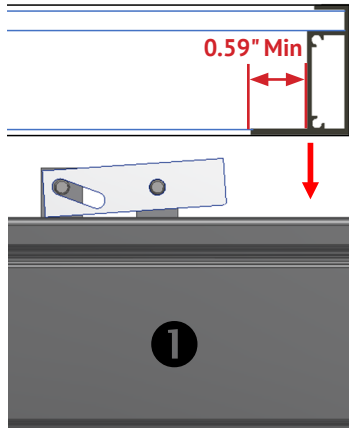



INSTALL FIRST MODULE: Install the first end module onto rails with the flange of the module frame positioned between end clamps at ends of rails.


NOTE: Requires minimum return flange length of 0.59" for Pro Series Hidden Endclamp to secure module

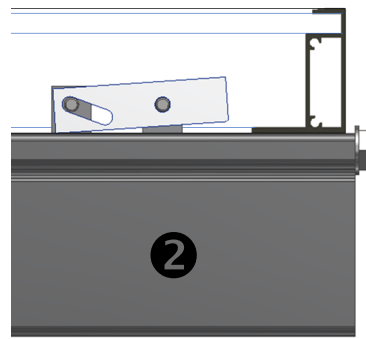


ENGAGE CLAMP: While holding module in position and with flange in full contact with rail, rotate end clamp bolt until clamp engages with flange to provide clamp force. **To ensure bolt is not over-torqued, use low torque setting on drill or If using an impact driver, stop rotation as soon as impact action of driver begins.**

Torque End clamp bolt to 5 ft-lbs, No anti-seize

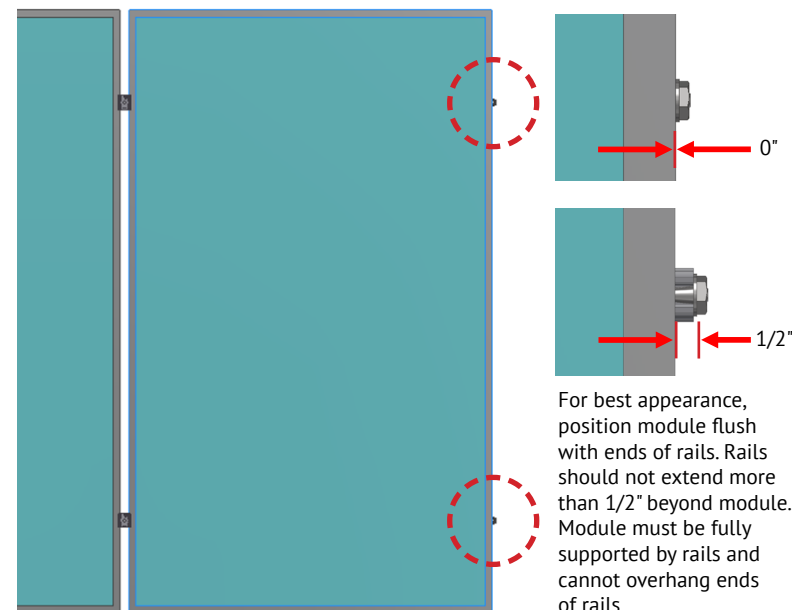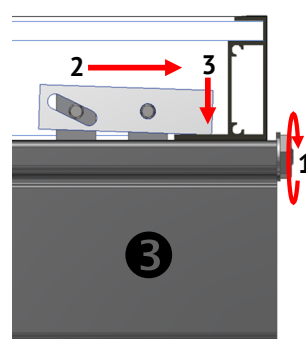


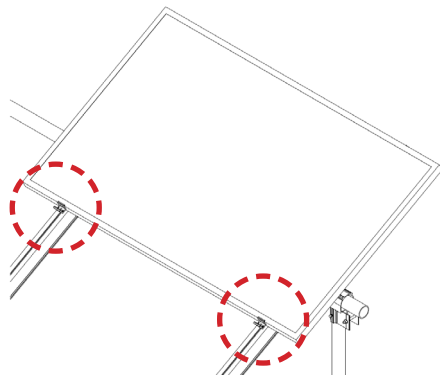


INSTALL MIDCLAMPS: Midclamp is supplied as an assembly with a T-bolt for module installation. Clamp assemblies may be positioned in rail near point of use prior to module placement.

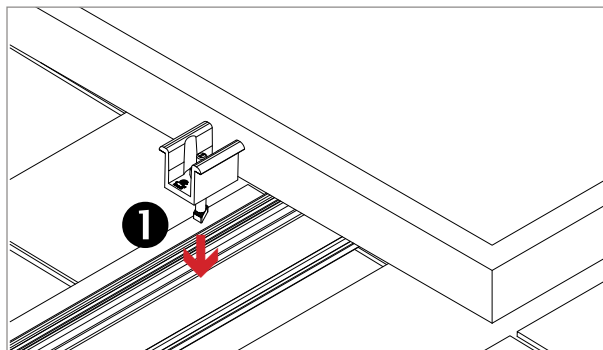

INSERT MIDCLAMP ASSEMBLY: Insert 1/4" T-Bolt into top slot of rail

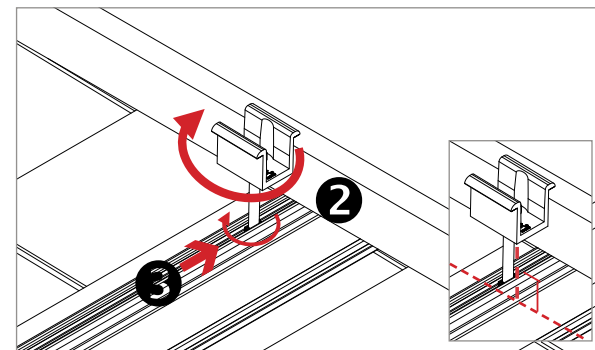


MIDCLAMP: Rotate midclamp assembly and slide until clamp is against module frame. Do not tighten nut until next module is in position. Ensure bolt is perpendicular to rail.

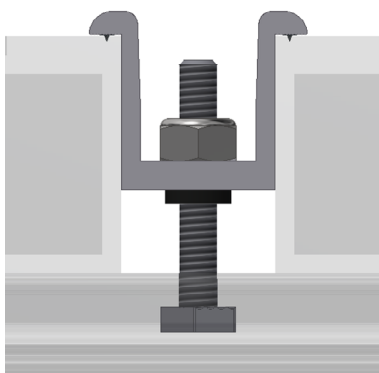


PLACE ADJACENT MODULE AGAINST CLAMPS: Modules must be tight against clamps with no gaps. Tighten nut to required torque.


TORQUE VALUE
11 ft-lbs. No anti-seize.

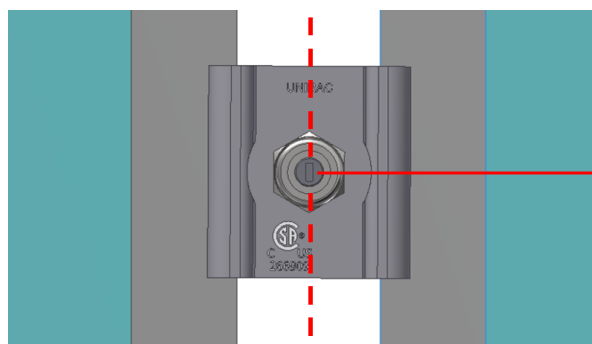


POSITION INDICATOR - SERRATED T-BOLT: Verify the T-bolt position indicator is perpendicular to the rail.

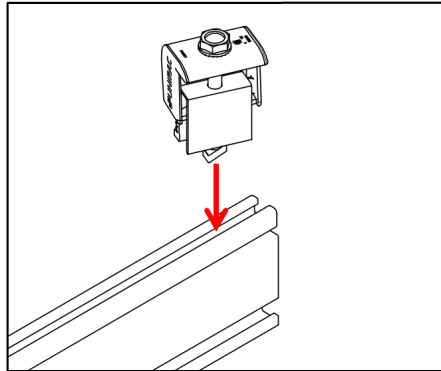


1. Position clamp to align T-bolt with rail slot. Lower clamp and Insert T-bolt into rail slot.

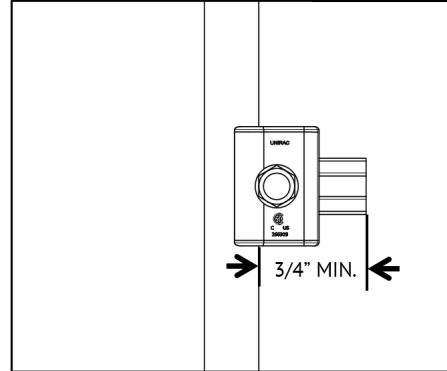


2. Rotate clamp clockwise 2/3 of a turn to engage T-bolt inside rail slot.

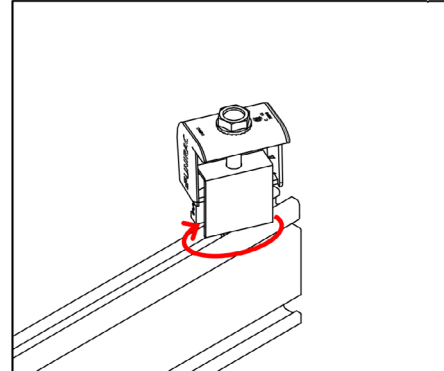


3. Place module at least 3/4" from end of rail and position clamp against module frame.

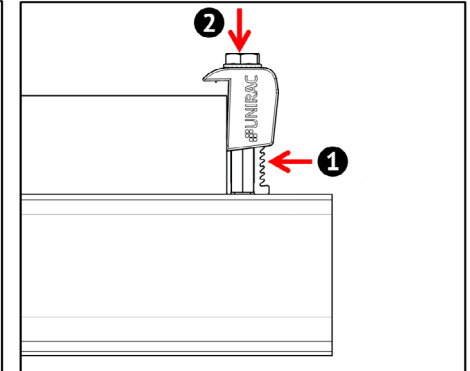


4. While applying pressure to hold the clamp against the module, push down on the module side of the clamp cap.

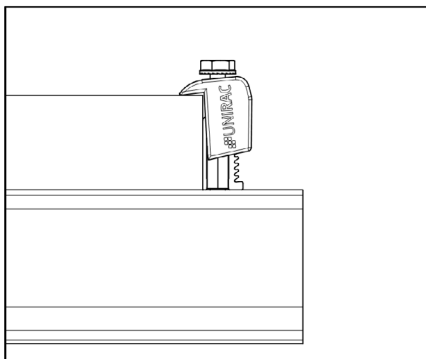

5. When the cap contacts the module frame, release and it will re-engage to the clamp base.

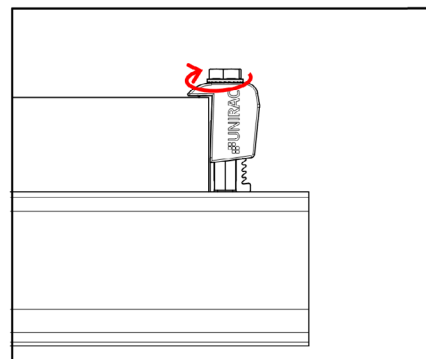


6. Tighten bolt.
Torque bolt to 15 ft-lbs.

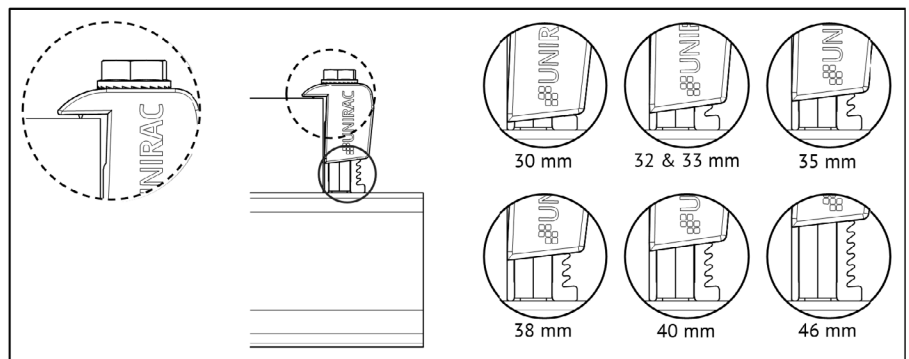


7. Confirm clamp is engaged in correct module height position and that the top of the cap is sitting level with the module frame.


NOTE: When installing 46mm modules, loosen bolt by 1 turn before positioning clamp against module frame. Do not force clamp onto module frame as this may damage the bonding pin.

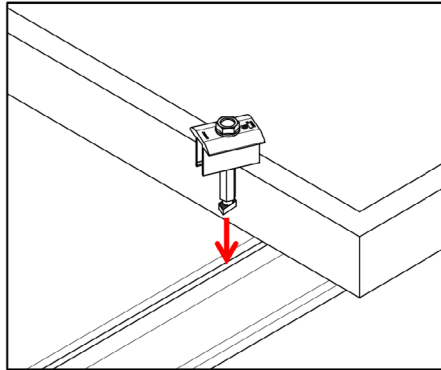


1. Position clamp to align T-bolt with rail slot. Lower clamp and insert T-bolt into rail slot

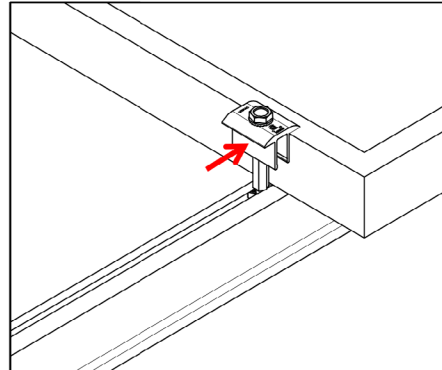


2. Rotate clamp clockwise 2/3 of a turn to engage T-bolt inside rail slot.

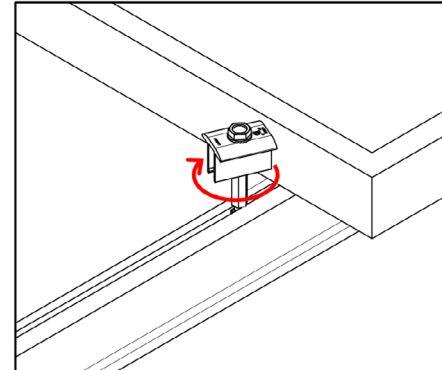


3. Slide clamp into position against module.

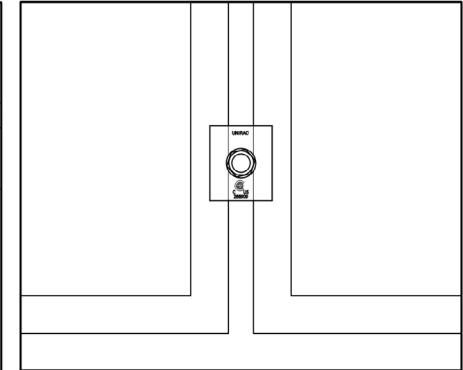

4. Place second module.

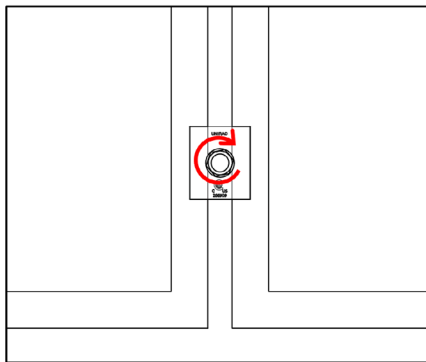

5. Tighten bolt.
Torque bolt to 15 ft-lbs.

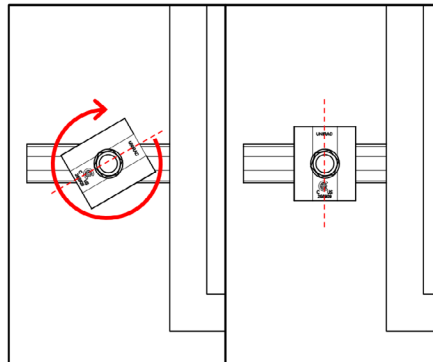

NOTE: If excessive force is applied in step 2, the cap may over-rotate causing it to be mis-aligned with the module frame. If this occurs, keep rotating the cap clockwise until it returns to the original position.